

# Technical Information

## Proline Promag W 10

Electromagnetic flowmeter



Flowmeter for basic applications in water & wastewater with simple operating concept

### Application

- The bidirectional measuring principle is virtually independent of pressure, density, temperature and viscosity
- Suitable for basic measuring tasks such as raw water infeed

### Device properties

- International drinking water approvals
- Degree of protection IP68 (Type 6P enclosure)
- System integration with HART, Modbus RS485
- Flexible operation with app and optional display

### Your benefits

- Reliable measurement with consistent accuracy with 0 x DN inlet run and no pressure loss
- Flexible engineering – sensor with fixed flanges or lap joint flanges
- Suitability for use – corrosion protection as per EN ISO 12944 for buried or underwater applications
- Improved plant availability – sensor meets industry-specific requirements
- Optimum usability – operation with mobile devices and SmartBlue App or touch screen display
- Easy, time-saving commissioning – guided parameter configuration in advance and in the field
- Integrated verification – Heartbeat Technology

## Table of contents

<b>About this document</b>	<b>4</b>	<b>Process</b>	<b>48</b>
Symbols used	4	Medium temperature range	48
Associated documentation	4	Conductivity	48
Ordering information	4	Flow limit	48
Registered trademarks	6	Pressure-temperature ratings	49
		Pressure tightness	52
		Pressure loss	52
<b>Function and system design</b>	<b>8</b>	<b>Mechanical construction</b>	<b>54</b>
Measuring principle	8	Weight	54
Product design	8	Measuring pipe specification	58
IT security	9	Materials	59
Device-specific IT security	9	Fitted electrodes	60
		Process connections	60
		Surface roughness	60
<b>Input</b>	<b>12</b>	<b>Dimensions in SI units</b>	<b>62</b>
Measured variable	12	Compact version	62
Operable flow range	12	Remote version	65
Measuring range	12	Fixed flange	70
		Lap joint flange	81
		Lap joint flange, stamped plate	84
		Accessories	85
<b>Output</b>	<b>16</b>	<b>Dimensions in US units</b>	<b>88</b>
Output versions	16	Compact version	88
Output signal	16	Remote version	91
Signal on alarm	19	Fixed flange	96
Low flow cut off	19	Lap joint flange	98
Galvanic isolation	19	Accessories	99
Protocol-specific data	19		
		<b>Local display</b>	<b>102</b>
<b>Power supply</b>	<b>22</b>	Operating concept	102
Terminal assignment	22	Operating options	102
Supply voltage	22	Operating tools	103
Power consumption	22		
Current consumption	22	<b>Certificates and approvals</b>	<b>106</b>
Power supply failure	23	Non-Ex approval	106
Electrical connection	23	Pressure Equipment Directive	106
Potential equalization	27	Drinking water approval	106
Terminals	29	Pharmaceutical compatibility	106
Cable entries	29	HART certification	106
		Radio approval	106
		Additional approvals	106
		Other standards and guidelines	106
<b>Cable specification</b>	<b>32</b>	<b>Application packages</b>	<b>110</b>
Requirements for connecting cable	32	Use	110
Ground cable requirements	32	Heartbeat Verification + Monitoring	110
Connecting cable requirements	33		
		<b>Accessories</b>	<b>112</b>
<b>Performance characteristics</b>	<b>36</b>	Device-specific accessories	112
Reference operating conditions	36	Communication-specific accessories	113
Maximum measured error	36	Service-specific accessory	113
Repeatability	36	System components	114
Influence of ambient temperature	36		
<b>Installation</b>	<b>38</b>		
Installation conditions	38		
<b>Environment</b>	<b>44</b>		
Ambient temperature range	44		
Storage temperature	44		
Atmosphere	44		
Degree of protection	44		
Vibration-resistance and shock-resistance	44		
Electromagnetic compatibility (EMC)	45		

## About this document

---

Symbols used	4
Associated documentation	4
Ordering information	4
Registered trademarks	6

## Symbols used

### Electronics

-  Direct current
-  Alternating current
-  Direct current and alternating current
-  Protective earthing

### Types of information

-  Preferred procedures, processes or actions
-  Permitted procedures, processes or actions
-  Forbidden procedures, processes or actions
-  Additional information
-  Reference to documentation
-  Reference to page
-  Reference to graphic

### Explosion protection

-  Hazardous area
-  Non-hazardous area

## Associated documentation

Technical Information	Overview of the device with the most important technical data.
Operating Instructions	All the information that is required in the various phases of the life cycle of the device: from product identification, incoming acceptance and storage, to mounting, connection, operation and commissioning through to troubleshooting, maintenance and disposal as well as the technical data and dimensions.
Sensor Brief Operating Instructions	Incoming acceptance, transport, storage and mounting of the device.
Transmitter Brief Operating Instructions	Electrical connection and commissioning of the device.
Description of Parameters	Detailed explanation of the menus and parameters.
Safety Instructions	Documents for the use of the device in hazardous areas.
Special Documentation	Documents with more detailed information on specific topics.
Installation Instructions	Installation of spare parts and accessories.

-  The device documentation is available online on the device product page and in the Downloads area: [www.endress.com](http://www.endress.com)

## Ordering information

Detailed ordering information is available for your nearest sales organization [www.addresses.endress.com](http://www.addresses.endress.com) or in the Product Configurator under [www.endress.com](http://www.endress.com) :

1. Click Corporate
2. Select the country
3. Click Products
4. Select the product using the filters and search field
5. Open the product page

The Configuration button to the right of the product image opens the Product Configurator.



**Product Configurator - the tool for individual product configuration**

- Up-to-the-minute configuration data
- Depending on the device: Direct input of measuring point-specific information such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly in the Endress+Hauser Online Shop

### Registered trademarks

**HART®**

Registered trademark of the FieldComm Group, Austin, USA

**Modbus®**

Registered trademark of SCHNEIDER AUTOMATION, INC.

**Bluetooth®**

The Bluetooth word mark and Bluetooth logos are registered trademarks of Bluetooth SIG, Inc. and any use of such marks by Endress+Hauser is under license. Other trademarks and trade names are those of their respective owners.

**Apple®**

Apple, the Apple logo, iPhone, and iPod touch are trademarks of Apple Inc., registered in the U.S. and other countries. App Store is a service mark of Apple Inc.

**Android®**

Android, Google Play and the Google Play logo are trademarks of Google Inc.


## Function and system design

---

Measuring principle	8
Product design	8
IT security	9
Device-specific IT security	9

## Measuring principle

Following *Faraday's law of magnetic induction*, a voltage is induced in a conductor moving through a magnetic field.

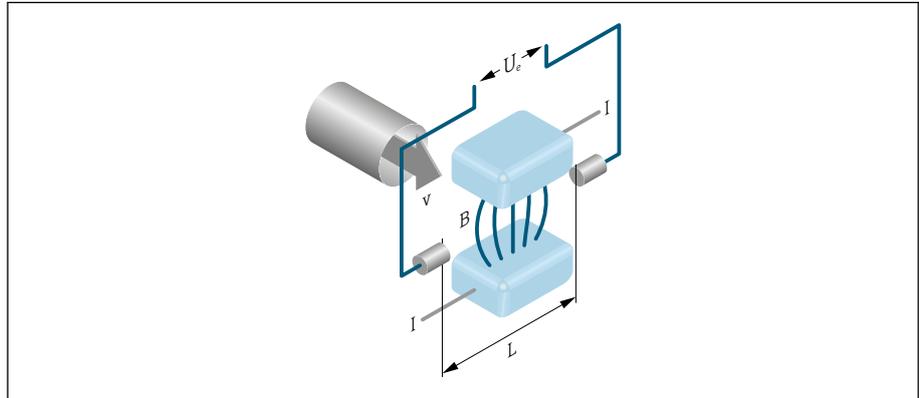

A0028962

- $U_e$  Induced voltage  
 $B$  Magnetic induction (magnetic field)  
 $L$  Electrode spacing  
 $I$  Current  
 $v$  Flow velocity

In the electromagnetic measuring principle, the flowing medium is the moving conductor. The voltage induced ( $U_e$ ) is proportional to the flow velocity ( $v$ ) and is supplied to the amplifier by means of two measuring electrodes. The flow volume ( $Q$ ) is calculated via the pipe cross-section ( $A$ ). The DC magnetic field is created through a switched direct current of alternating polarity.

### Formulae for calculation

- Induced voltage  $U_e = B \cdot L \cdot v$
- Volume flow  $Q = A \cdot v$

## Product design


The device consists of a transmitter and a sensor.

Two device versions are available:

- Compact version – transmitter and sensor form a mechanical unit.
- Remote version - transmitter and sensor are mounted in separate locations.

### Compact version

The transmitter and sensor form a mechanical unit.

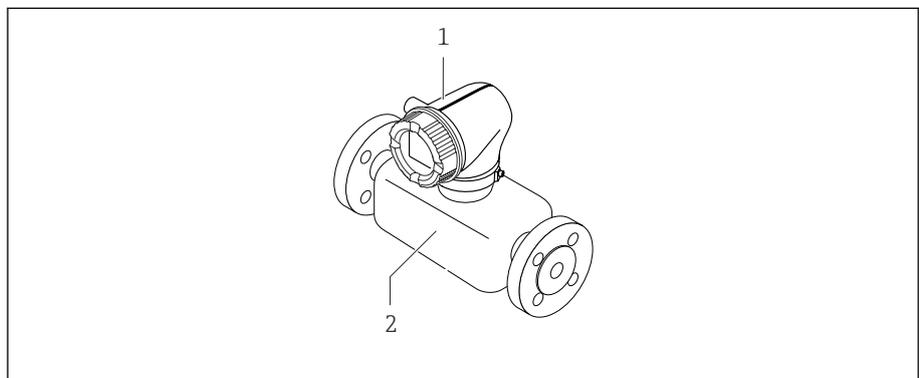


A0008262

- 1 Transmitter  
 2 Sensor

### Remote version

The transmitter and sensor are mounted in physically separate locations.

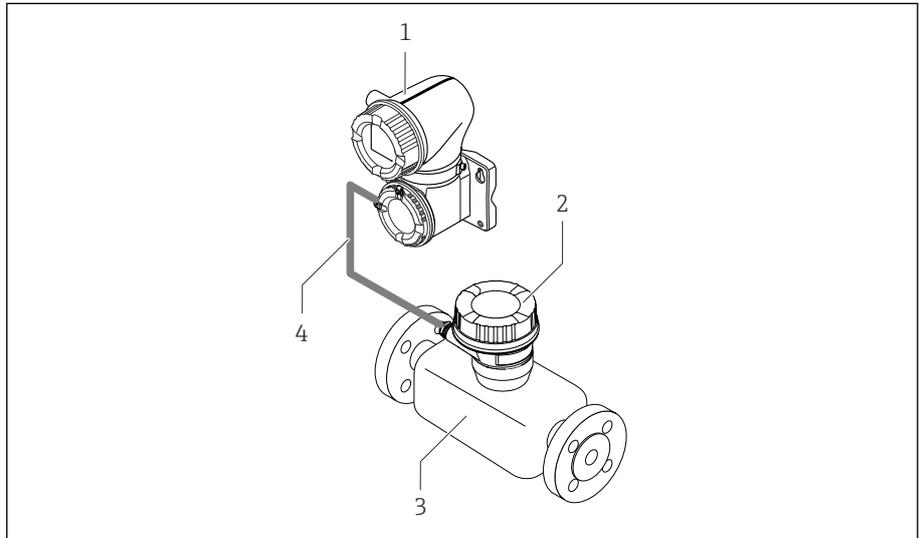

A0028196

- 1 Transmitter
- 2 Sensor connection housing
- 3 Sensor
- 4 Connecting cable

### Measuring system

Proline 10 transmitter	Promag W sensor	
	DN 25 to 300 mm (1 to 12 in)	DN > 300 mm (12 in)

### IT security

We only provide a warranty if the device is installed and used as described in the Operating Instructions. The device is equipped with security mechanisms to protect it against any inadvertent changes to the device settings.

IT security measures in line with operators' security standards and designed to provide additional protection for the device and device data transfer must be implemented by the operators themselves.

### Device-specific IT security

#### Access via Bluetooth

Secure signal transmission via Bluetooth uses an encryption method tested by the Fraunhofer Institute.

- Without the SmartBlue App, the device is not visible via Bluetooth.
- Only one point-to-point connection is established between the device and a smartphone or tablet.

### Access via the SmartBlue App

Two access levels (user roles) are defined for the device: the **Operator** user role and the **Maintenance** user role. The **Maintenance** user role is configured when the device leaves the factory.

If a user-specific access code is not defined (in the Enter access code parameter), the default setting **0000** continues to apply and the **Maintenance** user role is automatically enabled. The device's configuration data are not write-protected and can be edited at all times.

If a user-specific access code has been defined (in the Enter access code parameter), all the parameters are write-protected. The device is accessed with the **Operator** user role. When the user-specific access code is entered a second time, the **Maintenance** user role is enabled. All parameters can be written to.



For detailed information, see the "Description of Device Parameters" document pertaining to the device.

### Protecting access via a password

There are a variety of ways to protect against write access to the device parameters:

- User-specific access code:  
Protect write access to the device parameters via all the interfaces.
- Bluetooth key:  
The password protects access and the connection between an operating unit, e.g. a smartphone or tablet, and the device via the Bluetooth interface.

#### General notes on the use of passwords

- The access code and Bluetooth key supplied with the device must be defined during commissioning.
- Follow the general rules for generating a secure password when defining and managing the access code and Bluetooth key.
- The user is responsible for the management and careful handling of the access code and Bluetooth key.

### Write protection switch

The entire operating menu can be locked via the write protection switch. The values of the parameters cannot be changed. Write protection is disabled when the device leaves the factory.

Write protection is enabled with the write protection switch on the back of the display module.

## Input

---

Measured variable	12
Operable flow range	12
Measuring range	12

### Measured variable

Direct measured variables	<ul style="list-style-type: none"> <li>▪ Volume flow (proportional to induced voltage)</li> <li>▪ Conductivity (order code for "Sensor Option", option CX)</li> </ul>
Calculated measured variables	Mass flow

### Operable flow range

Over 1000 : 1

### Measuring range

Typically  $v = 0.01$  to  $10$  m/s ( $0.03$  to  $33$  ft/s) with the specified accuracy

Electrical conductivity:  $\geq 5$   $\mu\text{S/cm}$  for liquids in general

Flow characteristic values in SI units: DN 25 to 125 (1 to 4")

Nominal diameter		Recommended flow min./max. full scale value ( $v \sim 0.3/10$ m/s)	Full scale value current output ( $v \sim 2.5$ m/s)	Factory settings	
[mm]	[in]			Pulse value ( $\sim 2$ pulse/s)	Low flow cut off ( $v \sim 0.04$ m/s)
		[dm <sup>3</sup> /min]	[dm <sup>3</sup> /min]	[dm <sup>3</sup> ]	[dm <sup>3</sup> /min]
25	1	9 to 300	75	0.5	1
32	–	15 to 500	125	1	2
40	1 ½	25 to 700	200	1.5	3
50	2	35 to 1100	300	2.5	5
65	–	60 to 2000	500	5	8
80	3	90 to 3000	750	5	12
100	4	145 to 4700	1200	10	20
125	–	220 to 7500	1850	15	30

Flow characteristic values in SI units: DN 150 to 2400 (6 to 90")

Nominal diameter		Recommended flow min./max. full scale value ( $v \sim 0.3/10$ m/s)	Full scale value current output ( $v \sim 2.5$ m/s)	Factory settings	
[mm]	[in]			Pulse value ( $\sim 2$ pulse/s)	Low flow cut off ( $v \sim 0.04$ m/s)
		[m <sup>3</sup> /h]	[m <sup>3</sup> /h]	[m <sup>3</sup> ]	[m <sup>3</sup> /h]
150	6	20 to 600	150	0.025	2.5
200	8	35 to 1100	300	0.05	5
250	10	55 to 1700	500	0.05	7.5
300	12	80 to 2400	750	0.1	10
350	14	110 to 3300	1000	0.1	15
375	15	140 to 4200	1200	0.15	20
400	16	140 to 4200	1200	0.15	20
450	18	180 to 5400	1500	0.25	25
500	20	220 to 6600	2000	0.25	30
600	24	310 to 9600	2500	0.3	40
700	28	420 to 13500	3500	0.5	50
750	30	480 to 15000	4000	0.5	60

Nominal diameter		Recommended flow min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Factory settings	
[mm]	[in]			[m <sup>3</sup> /h]	Pulse value (~ 2 pulse/s) [m <sup>3</sup> ]
800	32	550 to 18000	4500	0.75	75
900	36	690 to 22500	6000	0.75	100
1000	40	850 to 28000	7000	1	125
-	42	950 to 30000	8000	1	125
1200	48	1250 to 40000	10000	1.5	150
-	54	1550 to 50000	13000	1.5	200
1400	-	1700 to 55000	14000	2	225
-	60	1950 to 60000	16000	2	250
1600	-	2200 to 70000	18000	2.5	300
-	66	2500 to 80000	20500	2.5	325
1800	72	2800 to 90000	23000	3	350
-	78	3300 to 100000	28500	3.5	450
2000	-	3400 to 110000	28500	3.5	450
-	84	3700 to 125000	31000	4.5	500
2200	-	4100 to 136000	34000	4.5	540
-	90	4300 to 143000	36000	5	570
2400	-	4800 to 162000	40000	5.5	650

Flow characteristic values in US units: 1 to 48" (DN 25 to 1200)

Nominal diameter		Recommended flow min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Factory settings	
[in]	[mm]			[gal/min]	Pulse value (~ 2 pulse/s) [gal]
1	25	2.5 to 80	18	0.2	0.25
-	32	4 to 130	30	0.2	0.5
1 ½	40	7 to 185	50	0.5	0.75
2	50	10 to 300	75	0.5	1.25
-	65	16 to 500	130	1	2
3	80	24 to 800	200	2	2.5
4	100	40 to 1250	300	2	4
-	125	60 to 1950	450	5	7
6	150	90 to 2650	600	5	12
8	200	155 to 4850	1200	10	15
10	250	250 to 7500	1500	15	30
12	300	350 to 10600	2400	25	45
14	350	500 to 15000	3600	30	60
15	375	600 to 19000	4800	50	60
16	400	600 to 19000	4800	50	60

Nominal diameter		Recommended flow min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Factory settings	
[in]	[mm]			Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
		[gal/min]	[gal/min]	[gal]	[gal/min]
18	450	800 to 24 000	6000	50	90
20	500	1 000 to 30 000	7500	75	120
24	600	1 400 to 44 000	10 500	100	180
28	700	1 900 to 60 000	13 500	125	210
30	750	2 150 to 67 000	16 500	150	270
32	800	2 450 to 80 000	19 500	200	300
36	900	3 100 to 100 000	24 000	225	360
40	1000	3 800 to 125 000	30 000	250	480
42	-	4 200 to 135 000	33 000	250	600
48	1200	5 500 to 175 000	42 000	400	600

Flow characteristic values in US units: 54 to 90" (DN 1400 to 2400)

Nominal diameter		Recommended flow min./max. full scale value (v ~ 0.3/10 m/s)	Full scale value current output (v ~ 2.5 m/s)	Factory settings	
[in]	[mm]			Pulse value (~ 2 pulse/s)	Low flow cut off (v ~ 0.04 m/s)
		[Mgal/d]	[Mgal/d]	[Mgal]	[Mgal/d]
54	-	9 to 300	75	0.0005	1.3
-	1400	10 to 340	85	0.0005	1.3
60	-	12 to 380	95	0.0005	1.3
-	1600	13 to 450	110	0.0008	1.7
66	-	14 to 500	120	0.0008	2.2
72	1800	16 to 570	140	0.0008	2.6
78	-	18 to 650	175	0.0010	3.0
-	2000	20 to 700	175	0.0010	2.9
84	-	24 to 800	190	0.0011	3.2
-	2200	26 to 870	210	0.0012	3.4
90	-	27 to 910	220	0.0013	3.6
-	2400	31 to 1030	245	0.0014	4.1

## Output

---

Output versions	16
Output signal	16
Signal on alarm	19
Low flow cut off	19
Galvanic isolation	19
Protocol-specific data	19

## Output versions

Order code for 020: output; input	Output version
Option B	<ul style="list-style-type: none"> <li>■ Current output 4 to 20 mA HART</li> <li>■ Pulse/frequency/switch output</li> </ul>
Option M	<ul style="list-style-type: none"> <li>■ Modbus RS485</li> <li>■ Current output 4 to 20 mA</li> </ul>

## Output signal

### Current output 4 to 20 mA HART

Signal mode	Choose via terminal assignment: <ul style="list-style-type: none"> <li>■ Active</li> <li>■ Passive</li> </ul>
Current range	Can be set to: <ul style="list-style-type: none"> <li>■ 4 to 20 mA NAMUR</li> <li>■ 4 to 20 mA US</li> <li>■ 4 to 20 mA</li> <li>■ Fixed current</li> </ul>
Max. output current	21.5 mA
Open-circuit voltage	DC < 28.8 V (active)
Max. input voltage	DC 30 V (passive)
Max. load	400 Ω
Resolution	1 μA
Damping	Configurable: 0 to 999.9 s
Assignable measured variables	<ul style="list-style-type: none"> <li>■ Off</li> <li>■ Volume flow</li> <li>■ Mass flow</li> <li>■ Flow velocity</li> <li>■ Conductivity*</li> <li>■ Electronic temperature</li> <li>■ Noise*</li> <li>■ Coil current shot time*</li> <li>■ Reference electrode potential against PE*</li> </ul> <p>* Visibility depends on order options or device settings</p>

### Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
--------------------	---

### Current output 4 to 20 mA

Signal mode	Choose via terminal assignment: <ul style="list-style-type: none"> <li>■ Active</li> <li>■ Passive</li> </ul>
Current range	Can be set to: <ul style="list-style-type: none"> <li>■ 4 to 20 mA NAMUR</li> <li>■ 4 to 20 mA US</li> <li>■ 4 to 20 mA</li> <li>■ Fixed current</li> </ul>
Max. output current	21.5 mA

<b>Open-circuit voltage</b>	DC < 28.8 V (active)
<b>Max. input voltage</b>	DC 30 V (passive)
<b>Max. load</b>	400 Ω
<b>Resolution</b>	1 μA
<b>Damping</b>	Configurable: 0 to 999.9 s
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ Volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Conductivity*</li> <li>▪ Electronic temperature</li> <li>▪ Noise*</li> <li>▪ Coil current shot time*</li> <li>▪ Reference electrode potential against PE*</li> </ul> <p>* Visibility depends on order options or device settings</p>

### Pulse/frequency/switch output

<b>Function</b>	Can be set to: <ul style="list-style-type: none"> <li>▪ Pulse output</li> <li>▪ Frequency output</li> <li>▪ Switch output</li> </ul>
<b>Version</b>	Open collector: Passive
<b>Input values</b>	<ul style="list-style-type: none"> <li>▪ DC 10.4 to 30 V</li> <li>▪ Max. 140 mA</li> </ul>
<b>Voltage drop</b>	<ul style="list-style-type: none"> <li>▪ ≤ DC 2 V @ 100 mA</li> <li>▪ ≤ DC 2.5 V @ max. input current</li> </ul>

<b>Pulse output</b>	
<b>Pulse width</b>	Configurable: 0.05 to 2 000 ms
<b>Max. pulse rate</b>	10 000 Impulse/s
<b>Pulse value</b>	Configurable
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>▪ Volume flow</li> <li>▪ Mass flow</li> </ul>

<b>Frequency output</b>	
<b>Output frequency</b>	Configurable: end value frequency 2 to 10 000 Hz ( $f_{\max} = 12\,500$ Hz)
<b>Damping</b>	Configurable: 0 to 999.9 s
<b>Pulse/pause ratio</b>	1:1
<b>Assignable measured variables</b>	<ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ Volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Conductivity*</li> <li>▪ Electronic temperature</li> <li>▪ Noise*</li> <li>▪ Coil current shot time*</li> <li>▪ Reference electrode potential against PE*</li> </ul> <p>* Visibility depends on order options or device settings</p>

<b>Switch output</b>	
<b>Switching behavior</b>	Binary, conductive or non-conductive
<b>Switching delay</b>	Configurable: 0 to 100 s
<b>Number of switching cycles</b>	Unlimited
<b>Assignable functions</b>	<ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ On</li> <li>▪ Diagnostic behavior: <ul style="list-style-type: none"> <li>▪ Alarm</li> <li>▪ Warning</li> <li>▪ Warning and alarm</li> </ul> </li> <li>▪ Limit value: <ul style="list-style-type: none"> <li>▪ Off</li> <li>▪ Volume flow</li> <li>▪ Mass flow</li> <li>▪ Flow velocity</li> <li>▪ Conductivity*</li> <li>▪ Corrected conductivity*</li> <li>▪ Totalizer 1...3</li> <li>▪ Electronic temperature</li> </ul> </li> <li>▪ Flow direction monitoring</li> <li>▪ Status <ul style="list-style-type: none"> <li>▪ Empty pipe detection</li> <li>▪ Low flow cut off</li> </ul> </li> </ul> <p>* Visibility depends on order options or device settings</p>

### Signal on alarm

Output behavior in the event of a device alarm (failure mode)

#### HART

<b>Device diagnostics</b>	Device condition can be read out via HART Command 48
---------------------------	--

#### Modbus RS485

<b>Failure mode</b>	Selectable: <ul style="list-style-type: none"> <li>▪ NaN value instead of current value</li> <li>▪ Last valid value</li> </ul>
---------------------	--

#### Current output 4 to 20 mA

<b>4 to 20 mA</b>	Selectable: <ul style="list-style-type: none"> <li>▪ Min. value: 3.59 mA</li> <li>▪ Max. value: 21.5 mA</li> <li>▪ Freely definable value between: 3.59 to 21.5 mA</li> <li>▪ Actual value</li> <li>▪ Last valid value</li> </ul>
-------------------	---

#### Pulse/frequency/switch output

<b>Pulse output</b>	Selectable: <ul style="list-style-type: none"> <li>▪ Actual value</li> <li>▪ No pulses</li> </ul>
<b>Frequency output</b>	Selectable: <ul style="list-style-type: none"> <li>▪ Actual value</li> <li>▪ 0 Hz</li> <li>▪ Defined value: 0 to 12 500 Hz</li> </ul>
<b>Switch output</b>	Selectable: <ul style="list-style-type: none"> <li>▪ Current status</li> <li>▪ Open</li> <li>▪ Closed</li> </ul>

#### Low flow cut off

The switch points for low flow cut off are user-selectable.

#### Galvanic isolation

The outputs are galvanically isolated from one another and from earth.

#### Protocol-specific data

##### HART

<b>Bus structure</b>	The HART signal overlays the 4 to 20 mA current output.
<b>Manufacturer ID</b>	0x11
<b>Device type ID</b>	0x71
<b>HART protocol revision</b>	7
<b>Device description files (DTM, DD)</b>	Information and files under: <a href="http://www.endress.com">www.endress.com</a>

HART load	At least 250 Ω
System integration	Measured variables via HART protocol

### Modbus RS485

Physical interface	RS485 in accordance with EIA/TIA-485 standard
Terminating resistor	Not integrated
Protocol	Modbus Applications Protocol Specification V1.1
Response times	<ul style="list-style-type: none"> <li>▪ Direct data access: typically 25 to 50 ms</li> <li>▪ Auto-scan buffer (data range): typically 3 to 5 ms</li> </ul>
Device type	Slave
Slave address range	1 to 247
Broadcast address range	0
Function codes	<ul style="list-style-type: none"> <li>▪ 03: Read holding register</li> <li>▪ 04: Read input register</li> <li>▪ 06: Write single registers</li> <li>▪ 08: Diagnostics</li> <li>▪ 16: Write multiple registers</li> <li>▪ 23: Read/write multiple registers</li> </ul>
Broadcast messages	Supported by the following function codes: <ul style="list-style-type: none"> <li>▪ 06: Write single registers</li> <li>▪ 16: Write multiple registers</li> <li>▪ 23: Read/write multiple registers</li> </ul>
Supported baud rate	<ul style="list-style-type: none"> <li>▪ 1 200 BAUD</li> <li>▪ 2 400 BAUD</li> <li>▪ 4 800 BAUD</li> <li>▪ 9 600 BAUD</li> <li>▪ 19 200 BAUD</li> <li>▪ 38 400 BAUD</li> <li>▪ 57 600 BAUD</li> <li>▪ 115 200 BAUD</li> </ul>
Data transfer mode	RTU
Data access	Each parameter can be accessed via Modbus RS485.  For Modbus register information
System integration	Information on system integration . <ul style="list-style-type: none"> <li>▪ Modbus RS485 information</li> <li>▪ Function codes</li> <li>▪ Register information</li> <li>▪ Response time</li> <li>▪ Modbus data map</li> </ul>

## Power supply

---

Terminal assignment	22
Supply voltage	22
Power consumption	22
Current consumption	22
Power supply failure	23
Electrical connection	23
Potential equalization	27
Terminals	29
Cable entries	29

## Terminal assignment



The terminal assignment is documented on an adhesive label.

The following terminal assignment is available:

*Current output 4 to 20 mA HART (active) and pulse/frequency/switch output*

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)
L/+	N/-	Current output 4 to 20 mA HART (active)		-		Pulse/frequency/switch output (passive)	

*Current output 4 to 20 mA HART (passive) and pulse/frequency/switch output*

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (+)	23 (-)
L/+	N/-	-		Current output 4 to 20 mA HART (passive)		Pulse/frequency/switch output (passive)	

*Modbus RS485 and current output 4 to 20 mA (active)*

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (B)	23 (A)
L/+	N/-	Current output 4 to 20 mA (active)		-		Modbus RS485	

*Modbus RS485 and current output 4 to 20 mA (passive)*

Supply voltage		Output 1				Output 2	
1 (+)	2 (-)	26 (+)	27 (-)	24 (+)	25 (-)	22 (B)	23 (A)
L/+	N/-	-		Current output 4 to 20 mA (passive)		Modbus RS485	

## Supply voltage

Order code for "Power supply"	Terminal voltage	Frequency range
Option D	DC 24 V	-20 to +30 %
Option E	AC 100 to 240 V	-15 to +10 %
Option I	DC 24 V	-20 to +30 %
	AC 100 to 240 V	-15 to +10 %
Option M non-hazardous area	DC 24 V	-20 to +30 %
	AC 100 to 240 V	-15 to +10 %

## Power consumption

- Transmitter: max. 10 W (active power)
- Switch-on current: max. 36 A (< 5 ms) as per NAMUR Recommendation NE 21

## Current consumption


- Max. 400 mA (24 V)
- Max. 200 mA (110 V, 50/60 Hz; 230 V, 50/60 Hz)

### Power supply failure

- Totalizers stop at the last value measured.
- Device configuration remains unchanged.
- Error messages (incl. total operated hours) are stored.

### Electrical connection

#### Connections and terminal assignment, remote version connecting cable

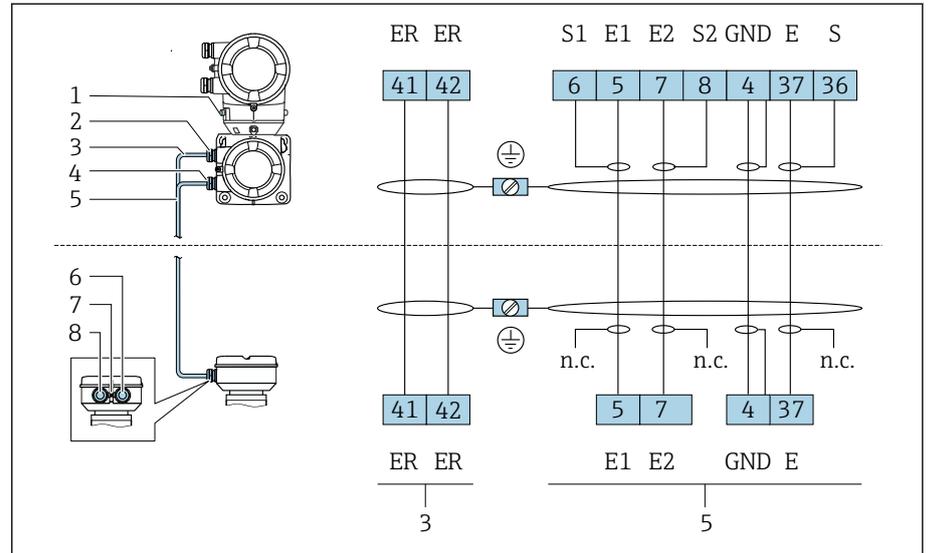


A0045474

- 1 Ground terminal, outer
- 2 Transmitter housing: cable entry for coil current cable
- 3 Coil current cable
- 4 Transmitter housing: cable entry for electrode cable
- 5 Electrode cable
- 6 Sensor connection housing: cable entry for electrode cable
- 7 Ground terminal, outer
- 8 Sensor connection housing: cable entry for coil current cable

### Transmitter terminal connections

**i** Terminal assignment → [Terminal assignment](#), 22

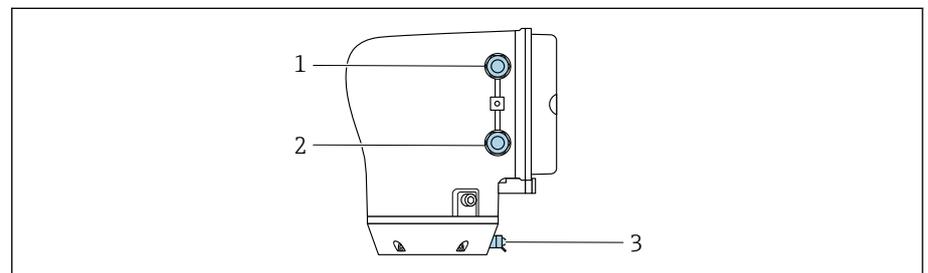


A0045438

- 1 Cable entry for power supply cable: supply voltage
- 2 Cable entry for signal cable
- 3 Ground terminal, outer

### Examples for electric terminals


#### Current output 4 to 20 mA HART (active)

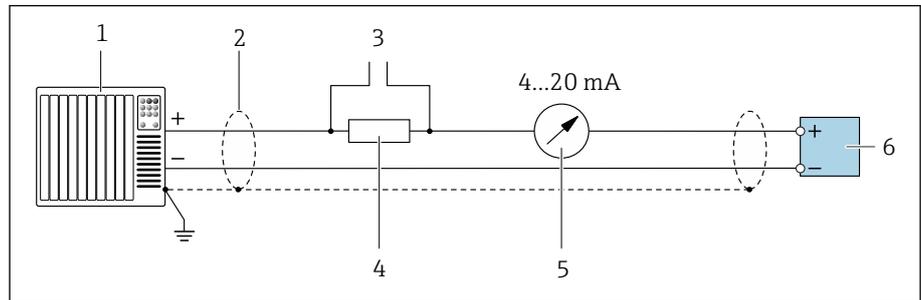

A0029055

- 1 Automation system with current input, e.g. PLC
- 2 Cable shield
- 3 Connection for HART operating devices
- 4 Resistor for HART communication ( $\geq 250 \Omega$ ); observe max. load.
- 5 Analog display unit; observe max. load.
- 6 Transmitter


#### Current output 4 to 20 mA HART (passive)

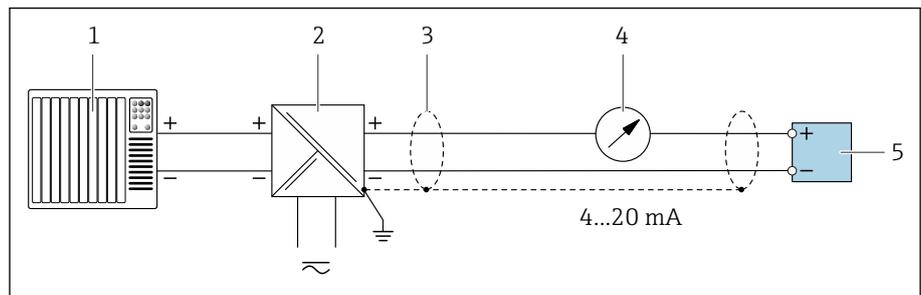

A0028762

- 1 Automation system with current input, e.g. PLC
- 2 Active barrier for supply voltage, e.g. RN221N
- 3 Cable shield
- 4 Analog display unit; observe max. load.
- 5 Transmitter

HART input (passive)

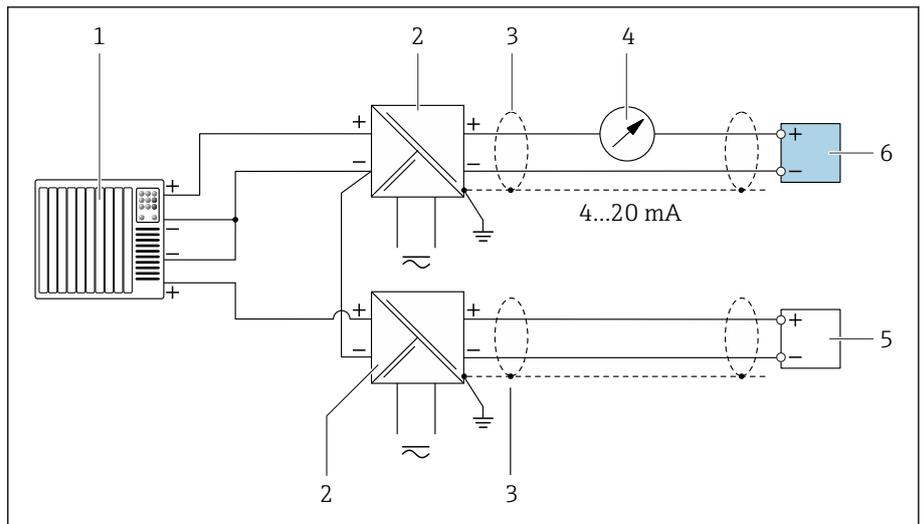


A0028763

1 Connection example for HART input with a common negative (passive)

- 1 Automation system with current input, e.g. PLC
- 2 Active barrier for supply voltage, e.g. RN221N
- 3 Cable shield
- 4 Analog display unit: observe max. load.
- 5 Pressure measuring device, e.g. Cerabar M, Cerabar S: observe requirements
- 6 Transmitter

Modbus RS485

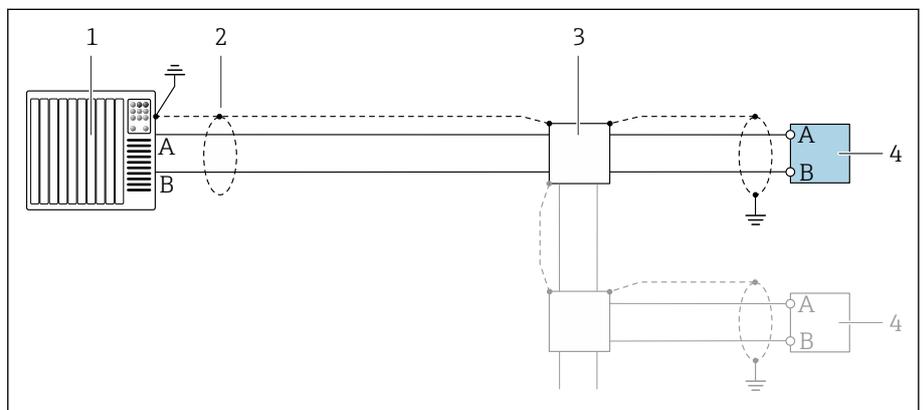


A0028765

2 Connection example for Modbus RS485, non-hazardous area and Zone 2; Class I, Division 2

- 1 Automation system, e.g. PLC
- 2 Cable shield
- 3 Distribution box
- 4 Transmitter


Current output 4 to 20 mA (active)

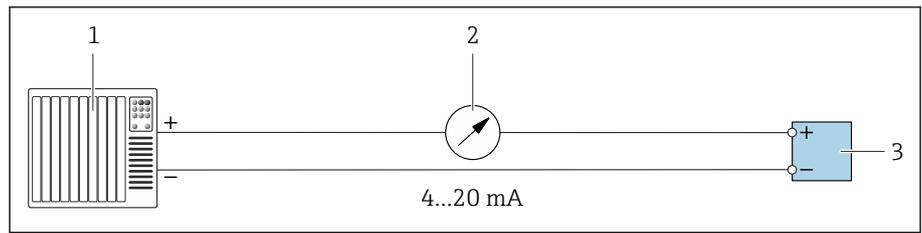

A0028758

- 1 Automation system with current input, e.g. PLC
- 2 Analog display unit: observe max. load.
- 3 Transmitter


Current output 4 to 20 mA (passive)

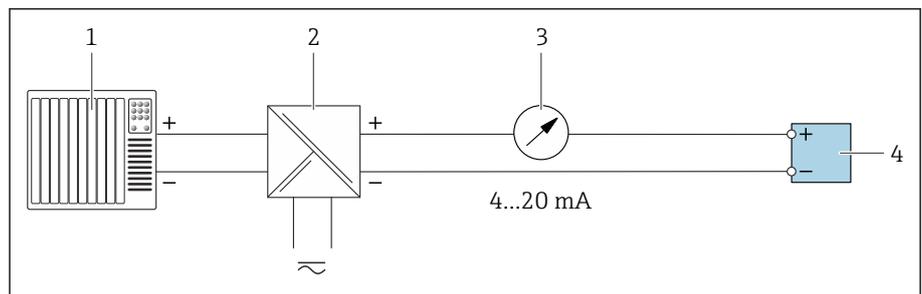

A0028759

- 1 Automation system with current input, e.g. PLC
- 2 Active barrier for supply voltage, e.g. RN221N
- 3 Analog display unit: observe max. load.
- 4 Transmitter


Pulse/frequency output (passive)

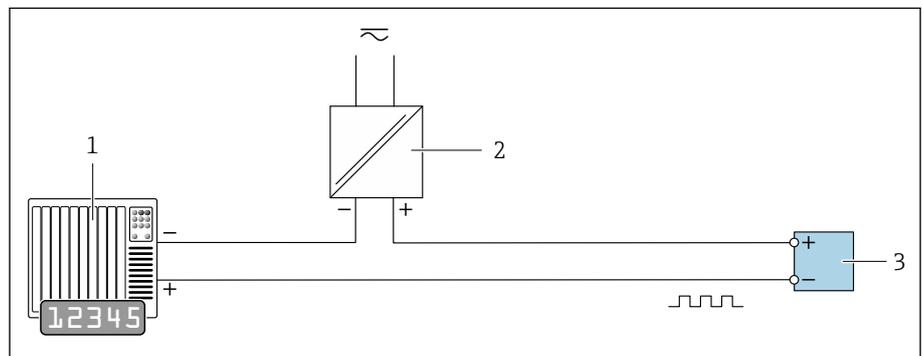

A0028761

- 1 Automation system with pulse output and frequency input, e.g. PLC
- 2 Supply voltage
- 3 Transmitter: observe input values.

Switch output (passive)

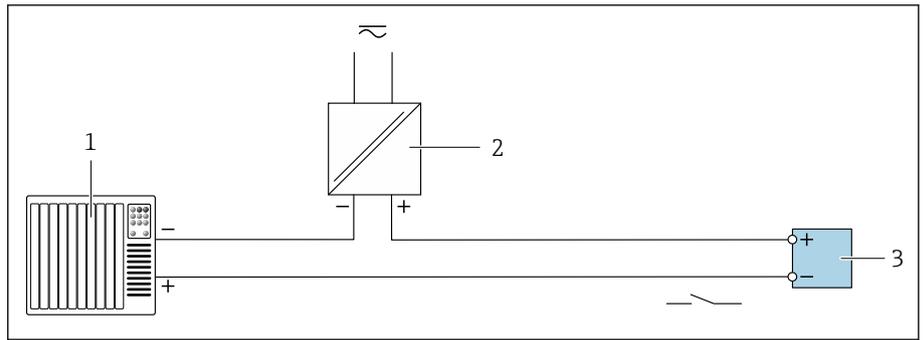

- 1 Automation system with switch input, e.g. PLC
- 2 Supply voltage
- 3 Transmitter: observe input values.

Potential equalization

Introduction

Correct potential equalization (equipotential bonding) is a prerequisite for stable and reliable flow measurement. Inadequate or incorrect potential equalization can result in device failure and present a safety hazard.

The following requirements must be observed to ensure correct, trouble-free measurement:


- The principle that the medium, the sensor and the transmitter must be at the same electrical potential applies.
- Take in-company grounding guidelines, materials and the grounding conditions and potential conditions of the pipe into consideration.
- Any necessary potential equalization connections must be established by ground cables with a minimum cross-section of 6 mm<sup>2</sup> (0.0093 in<sup>2</sup>).
- In the case of remote device versions, the ground terminal in the example always refers to the sensor and not to the transmitter.

**i** You can order accessories such as ground cables and ground disks from Endress +Hauser → *Device-specific accessories*, 112

Abbreviations used

- PE (Protective Earth): potential at the protective earth terminals of the device
- P<sub>P</sub> (Potential Pipe): potential of the pipe, measured at the flanges
- P<sub>M</sub> (Potential Medium): potential of the medium

Connection examples for standard situations

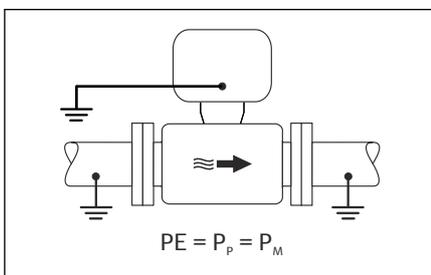


Unlined and grounded metal pipe

- Potential equalization is via the measuring pipe.
- The medium is set to ground potential.

Starting conditions:

- Pipes are correctly grounded on both sides.
- Pipes are conductive and at the same electrical potential as the medium
- ▶ Connect the connection housing of the transmitter or sensor to ground potential by means of the ground terminal provided for this purpose.

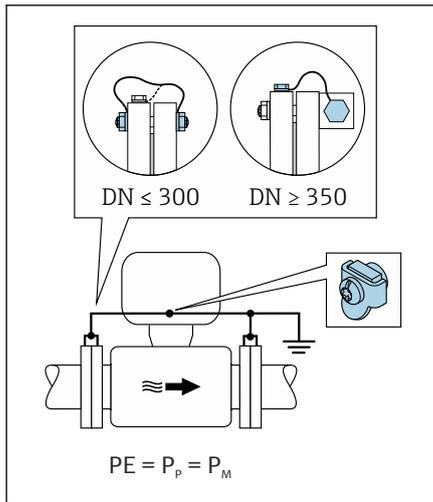


#### Unlined metal pipe

- Potential equalization is via the ground terminal and pipe flanges.
- The medium is set to ground potential.

Starting conditions:

- Pipes are not sufficiently grounded.
- Pipes are conductive and at the same electrical potential as the medium

1. Connect both sensor flanges to the pipe flange via a ground cable and ground them.
2. Connect the connection housing of the transmitter or sensor to ground potential by means of the ground terminal provided for this purpose.
3. If DN  $\leq$  300 (12"): mount the ground cable directly on the conductive flange coating of the sensor with the flange screws.
4. If DN  $\geq$  350 (14"): mount the ground cable directly on the metal transport bracket. Observe screw tightening torques: see the Brief Operating Instructions for the sensor.

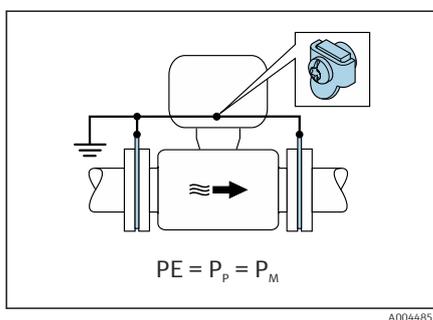

#### Plastic pipe or pipe with insulating liner

- Potential equalization is via the ground terminal and ground disks.
- The medium is set to ground potential.


Starting conditions:

- The pipe has an insulating effect.
- Low-impedance medium grounding close to the sensor is not guaranteed.
- Equalizing currents through the medium cannot be ruled out.

1. Connect the ground disks to the ground terminal of the connection housing of the transmitter or sensor via the ground cable.
2. Connect the connection to ground potential.

#### Connection example with the potential of medium not equal to protective earth without the "Measurement isolated from ground" option

In these cases, the medium potential can differ from the potential of the device.

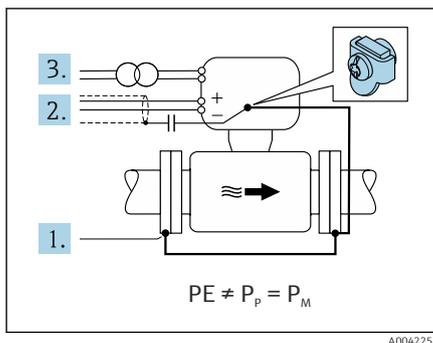

#### Metal, ungrounded pipe

The sensor and transmitter are installed in a way that provides electrical insulation from PE, e.g. applications for electrolytic processes or systems with cathodic protection.

Starting conditions:

- Unlined metal pipe
- Pipes with an electrically conductive liner

1. Connect the pipe flanges and transmitter via the ground cable.
2. Route the shielding of the signal lines via a capacitor (recommended value 1.5  $\mu$ F/50V).
3. Device connected to power supply such that it is floating in relation to the protective earth (isolation transformer). This measure is not required in the case of 24V DC supply voltage without PE (= SELV power unit).

#### Connection examples with the potential of medium not equal to protective earth with the "Measurement isolated from ground" option

In these cases, the medium potential can differ from the potential of the device.

#### Introduction

The "Measurement isolated from ground" option enables the galvanic isolation of the measuring system from the device potential. This minimizes harmful equalizing currents caused by differences in potential between the medium and the device. The


"Measurement isolated from ground" option is optionally available: order code for "Sensor option", option CV

*Operating conditions for the use of the "Measurement isolated from ground" option*

Device version	Compact version and remote version (length of connecting cable ≤ 10 m)
Differences in voltage between medium potential and device potential	As small as possible, usually in the mV range
Alternating voltage frequencies in the medium or at ground potential (PE)	Below typical power line frequency in the country

**i** To achieve the specified conductivity measuring accuracy, a conductivity calibration is recommended when the device is installed.

A full pipe adjustment is recommended when the device is installed.

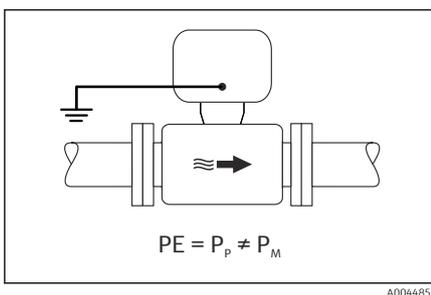


**Plastic pipe**

Sensor and transmitter are correctly grounded. A difference in potential can occur between the medium and protective earth. Potential equalization between  $P_M$  and PE via the reference electrode is minimized with the "Measurement isolated from ground" option.

Starting conditions:

- The pipe has an insulating effect.
- Equalizing currents through the medium cannot be ruled out.

1. Use the "Measurement isolated from ground" option, while observing the operating conditions for measurement isolated from ground.
2. Connect the connection housing of the transmitter or sensor to ground potential by means of the ground terminal provided for this purpose.

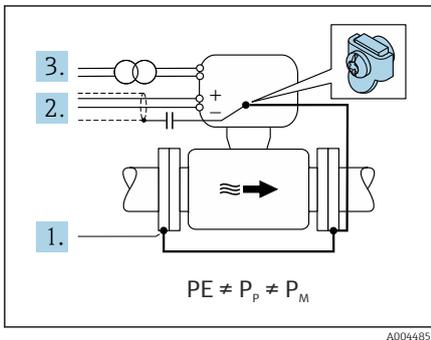

**Metal, ungrounded pipe with insulating liner**

The sensor and transmitter are installed in a way that provides electrical insulation from PE. The medium and pipe have different potentials. The "Measurement isolated from ground" option minimizes harmful equalizing currents between  $P_M$  and  $P_P$  via the reference electrode.

Starting conditions:

- Metal pipe with insulating liner
- Equalizing currents through the medium cannot be ruled out.

1. Connect the pipe flanges and transmitter via the ground cable.
2. Route the shielding of the signal cables via a capacitor (recommended value 1.5µF/50V).
3. Device connected to power supply such that it is floating in relation to the protective earth (isolation transformer). This measure is not required in the case of 24V DC supply voltage without PE (= SELV power unit).
4. Use the "Measurement isolated from ground" option, while observing the operating conditions for measurement isolated from ground.

**Terminals**

Spring terminals

- Suitable for strands and strands with ferrules.
- Conductor cross-section 0.2 to 2.5 mm<sup>2</sup> (24 to 12 AWG).

**Cable entries**

- Cable gland: M20 × 1.5 for cable Ø6 to 12 mm (0.24 to 0.47 in)
- Thread for cable entry:
  - NPT ½"
  - G ½", G ½" Ex d
  - M20



## Cable specification

---

Requirements for connecting cable	32
Ground cable requirements	32
Connecting cable requirements	33

## Requirements for connecting cable

### Electrical safety

As per applicable national regulations.

### Permitted temperature range

- Observe the installation guidelines that apply in the country of installation.
- The cables must be suitable for the minimum temperatures and maximum temperatures to be expected.

### Power supply cable (incl. conductor for the inner ground terminal)

- A standard installation cable is sufficient.
- Provide grounding according to applicable national codes and regulations.


### Signal cable

- Current output 4 to 20 mA HART:  
A shielded cable is recommended, observe the grounding concept of the facility.
- Pulse/frequency/switch output:  
Standard installation cable
- Modbus RS485:  
Cable type A according to EIA/TIA-485 standard is recommended
- Current output 4 to 20 mA:  
Standard installation cable

### Ground cable requirements

Copper wire: at least 6 mm<sup>2</sup> (0.0093 in<sup>2</sup>)

### Connecting cable requirements

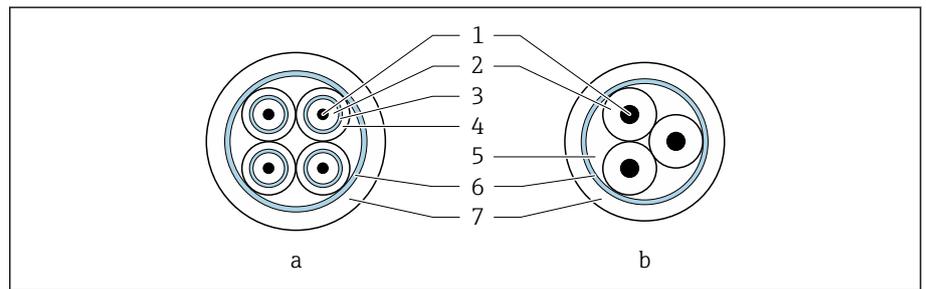

3 Cable cross-section

- a Electrode cable
- b Coil current cable
- 1 Core
- 2 Core insulation
- 3 Core shield
- 4 Core jacket
- 5 Core reinforcement
- 6 Cable shield
- 7 Outer jacket

#### **i** Preterminated connecting cables

Two connecting cable versions can be ordered from Endress+Hauser for use with IP68 protection:

- Cable is already connected to the sensor.
- Cable is connected by the customer (incl. tools for sealing the connection compartment).

#### **i** Armored connecting cable

Armored connecting cables with additional, metal reinforcing braid can be ordered from Endress+Hauser. Armored connecting cables are used:

- When laying the cable directly in the ground
- Where there is a risk of damage from rodents
- If using the device below IP68 degree of protection

### Electrode cable

<b>Design</b>	3×0.38 mm <sup>2</sup> (20 AWG) with common, braided copper shield (∅ ~ 9.5 mm (0.37 in)) and individual shielded cores  If using the empty pipe detection (EPD) function: 4×0.38 mm <sup>2</sup> (20 AWG) with common, braided copper shield (∅ ~ 9.5 mm (0.37 in)) and individual shielded cores
<b>Conductor resistance</b>	≤ 50 Ω/km (0.015 Ω/ft)
<b>Capacitance: core/shield</b>	≤ 420 pF/m (128 pF/ft)
<b>Cable length</b>	Depending on the medium conductivity: maximum 200 m (656 ft)
<b>Cable lengths (available for order)</b>	5 m (15 ft), 10 m (30 ft), 20 m (60 ft) or variable length: maximum 200 m (656 ft) Armored cables: variable length up to maximum 200 m (656 ft)
<b>Operating temperature</b>	-20 to +80 °C (-4 to +176 °F)

### Coil current cable

<b>Design</b>	3×0.38 mm <sup>2</sup> (20 AWG) with common, braided copper shield (∅ ~ 9.5 mm (0.37 in)) and individual shielded cores
<b>Conductor resistance</b>	≤ 37 Ω/km (0.011 Ω/ft)
<b>Capacitance: core/shield</b>	≤ 120 pF/m (37 pF/ft)
<b>Cable length</b>	Depends on the medium conductivity, max. 200 m (656 ft)

---

<b>Cable lengths (available for order)</b>	5 m (15 ft), 10 m (30 ft), 20 m (60 ft) or variable length up to max. 200 m (656 ft) Armored cables: variable length up to max. 200 m (656 ft)
<b>Operating temperature</b>	-20 to +80 °C (-4 to +176 °F)
<b>Test voltage for cable insulation</b>	≤ AC 1 433 V r.m.s. 50/60 Hz or ≥ DC 2 026 V

## Performance characteristics

---

Reference operating conditions	36
Maximum measured error	36
Repeatability	36
Influence of ambient temperature	36

### Reference operating conditions

- Error limits based on ISO 20456:2017
- Water, typically: +15 to +45 °C (+59 to +113 °F); 0.5 to 7 bar (7.3 to 101 psi)
- Data as indicated in the calibration protocol
- Accuracy based on accredited calibration rigs according to ISO 17025

**i** To obtain measured errors, use the *Applicator* sizing tool → *Service-specific accessory*, 113

### Maximum measured error


o. r. = of reading

### Error limits under reference operating conditions

#### Volume flow

±0.5 % o. r. ±1 mm/s (±0.04 in/s)

**i** Fluctuations in the supply voltage do not have any effect within the specified range.

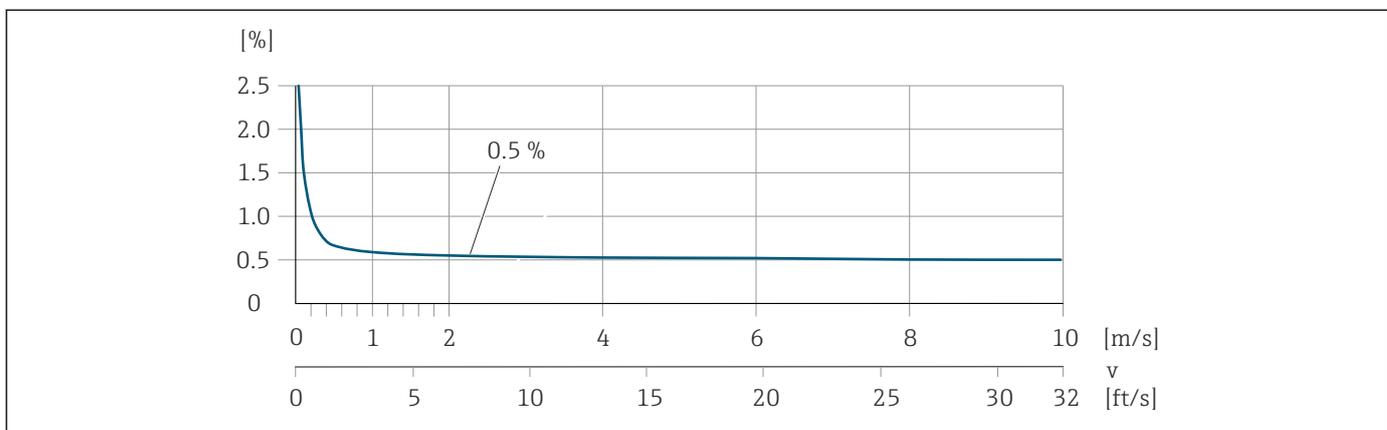

A0045827

#### Electrical conductivity

Max. measured error not specified.

### Accuracy of outputs

Current output	±5 µA
Pulse/frequency output	Max. ±100 ppm o. r. (across the entire ambient temperature range)

### Repeatability

Volume flow	Max. ±0.1 % o. r. ± 0.5 mm/s (0.02 in/s)
Electrical conductivity	Max. ±5 % o. r. (5 to 100 000 µS/cm)

### Influence of ambient temperature

Current output	Temperature coefficient max. 1 µA/°C
Pulse/frequency output	No additional effect. Is included in the accuracy.


# Installation

---

Installation conditions

## Installation conditions

### Flow direction

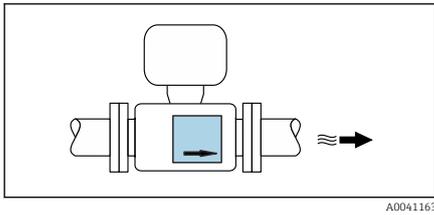


Install the device in the direction of flow.



Note the direction of arrow on the nameplate.


### Inlet runs and outlet runs

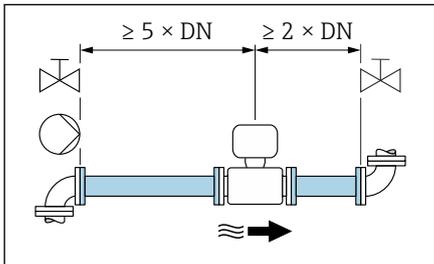


Ensure straight, undisturbed inlet and outlet runs.



To avoid negative pressure and to comply with accuracy specifications, install the sensor upstream from assemblies that produce turbulence (e.g. valves, T-sections) and downstream from pumps → *Installation near pumps*, 40.

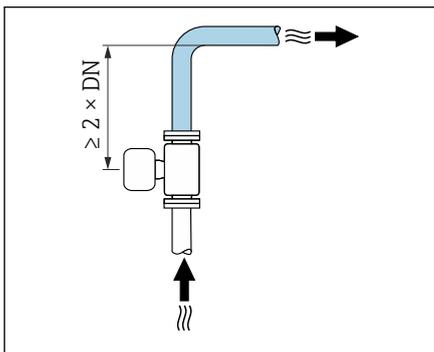

Keep a sufficient distance to the next pipe elbow.

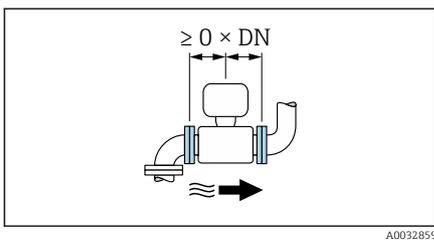


Inlet and outlet runs do not need to be considered for devices with the order code for "Design", option H, I.

### Orientations

#### Vertical orientation, upward direction of flow


For all applications.

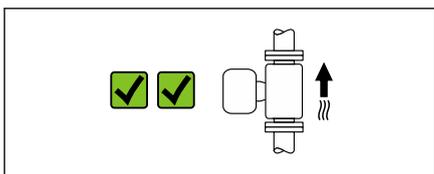


#### Horizontal orientation, transmitter at top

This orientation is suitable for the following applications:


- For low process temperatures in order to maintain the minimum ambient temperature for the transmitter.
- For empty pipe detection, even in the case of empty or partially filled measuring pipes.

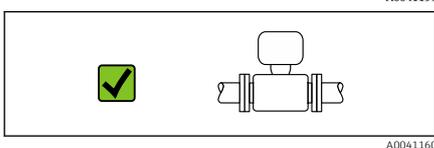


### Mounting locations

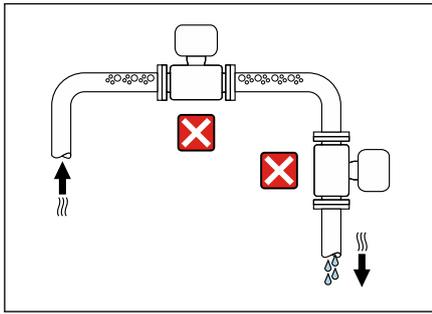

- Do not install the device at the highest point of the pipe.
- Do not install the device upstream from a free pipe outlet in a down pipe.

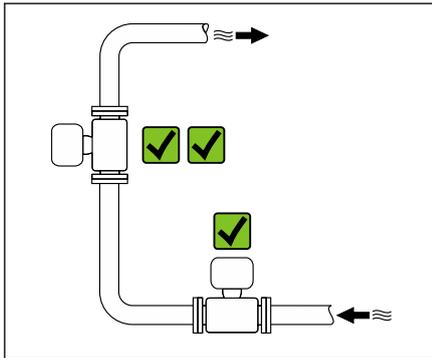


### Installation near control valves

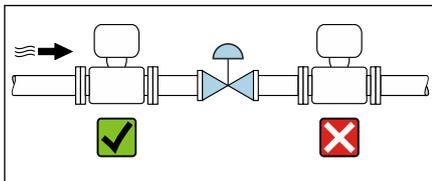

Install the device in the direction of flow upstream from the control valve.

### Installation upstream from a down pipe

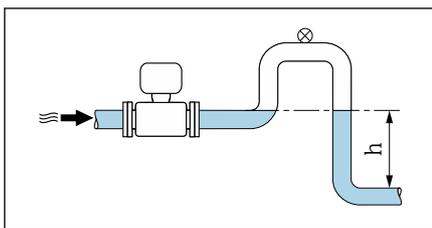


#### NOTICE

**Negative pressure in the measuring pipe can damage the liner!**

- ▶ If installing upstream from down pipes with a length  $h \geq 5$  m (16.4 ft): install a siphon with a vent valve downstream from the device.

**i** This arrangement prevents the flow of liquid stopping in the pipe and air entrainment.


### Installation with partially filled pipes

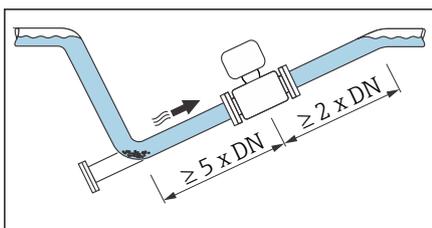

- Partially filled pipes with a gradient require a drain-type configuration.
- The installation of a cleaning valve is recommended.

**i** Inlet and outlet runs do not need to be considered for devices with the order code for "Design", option H, I.

### Installation near pumps

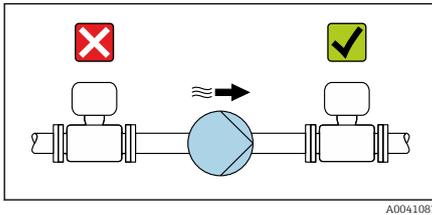

#### NOTICE

#### Negative pressure in the measuring pipe can damage the liner!

- ▶ Install the device in the direction of flow downstream from the pump.
- ▶ Install pulsation dampers if reciprocating, diaphragm or peristaltic pumps are used.

### Installation of very heavy devices


Support is required with nominal diameters of  $DN \geq 350$  (14") and higher.

#### NOTICE

#### Damage to the device!

If incorrect support is provided, the sensor housing could buckle and the internal magnetic coils could be damaged.

- ▶ Only provide supports at the pipe flanges.

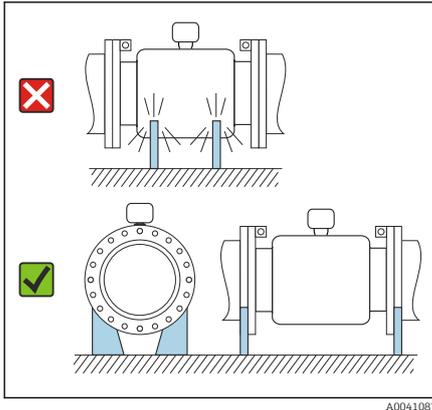


### Pipe vibrations

A remote version is recommended in the event of strong pipe vibrations.


#### NOTICE

#### Pipe vibrations can damage the device!

- ▶ Do not expose the device to strong vibrations.
- ▶ Support the pipe and fix it in place.
- ▶ Support the device and fix it in place.
- ▶ Mount the sensor and transmitter separately.

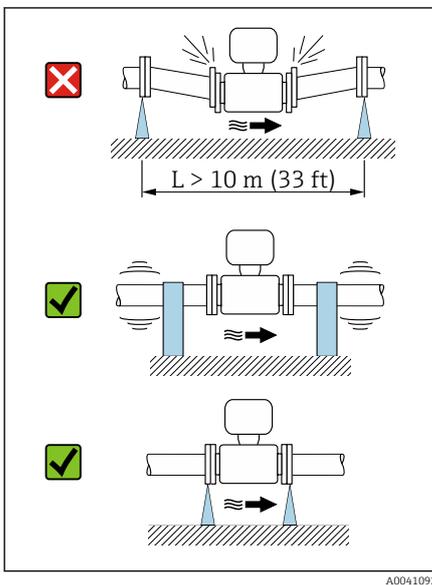

### Adapters

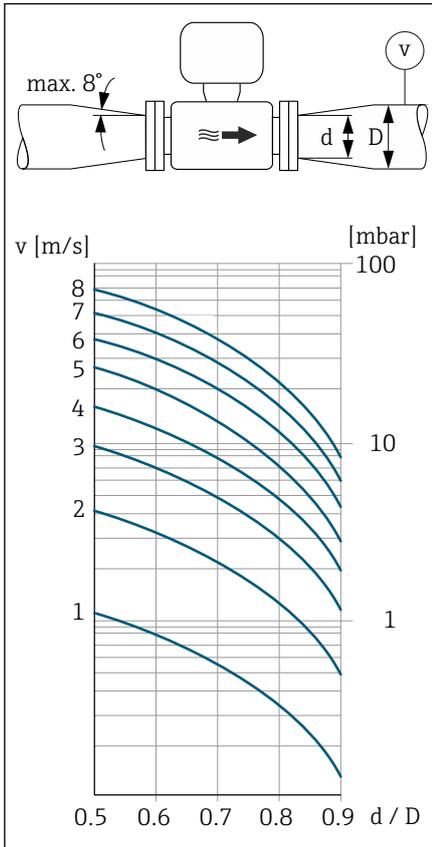

A0041086

Suitable adapters (double-flange reducers) can be used to install the sensor in larger-diameter pipes. The resulting higher rate of flow improves measuring accuracy with very slow-moving media.

**i** The nomogram shown here can be used to calculate the pressure loss caused by reducers and expanders. It only applies to liquids with a viscosity similar to that of water.

1. Calculate the ratio of the diameters  $d/D$ .
2. Determine the flow velocity after the reduction.
3. From the chart, determine the pressure loss as a function of the flow velocity  $v$  and the  $d/D$  ratio.


### Seals

Note the following when installing seals:

- For liner with polyurethane: no seal is required.
- For "PTFE" liner: no seal is required.
- For liner with hard rubber: seal is **always** required.
- For DIN flanges: only install seals according to DIN EN 1514-1.

### Thermal insulation

The sensor and pipe must be insulated in the event of very hot media. The insulation helps to slow energy loss and prevent injuries from accidental contact with hot pipes.

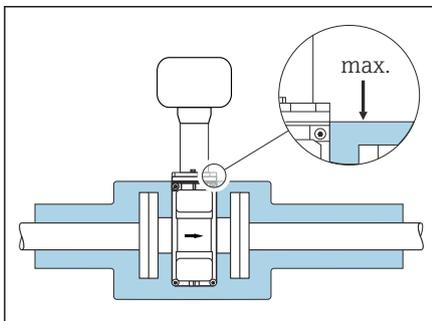

A0041093


### NOTICE

**If the meter electronics overheat this can damage the device!**

- ▶ Keep the housing support completely free (heat dissipation).
- ▶ Provide insulation but make sure it does not go beyond the upper edge of the two sensor half-shells.


### Magnetism and static electricity

Do not install the device near magnetic fields, e.g. motors, pumps, transformers.

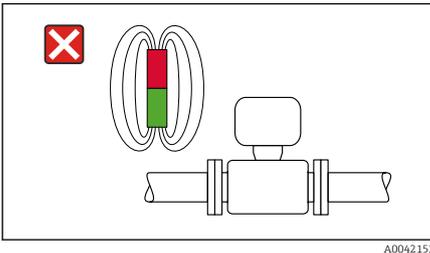

### Outdoor use

- Avoid exposure to direct sunlight.
- Install in a location protected from sunlight.
- Avoid direct exposure to weather conditions.
- Use a weather protection cover → *Transmitter*, ☰ 112.

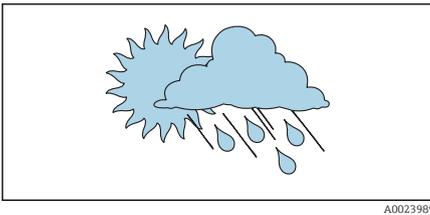

### Immersion in water

**i** Only the remote version with IP68, type 6P, is suitable for immersion in water.

#### NOTICE


If the maximum water depth and operating duration are exceeded, this will damage the device!

- ▶ Observe the maximum water depth and operating duration.

#### Order code for "Sensor option", options CA, CB

Use of device under water at a maximum water depth of:

- 3 m (10 ft): permanent use
- 10 m (30 ft): max. 48 hours

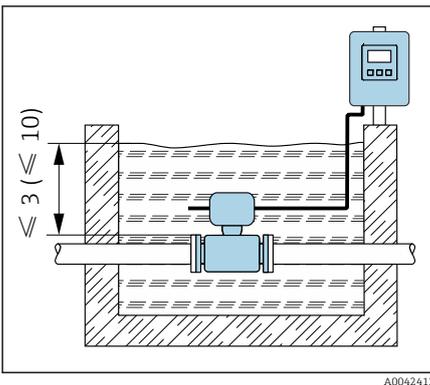


### Use in buried applications

**i** Only the remote version with IP68 is suitable for use in buried applications.

#### Order code for "Sensor option", options CD, CE

The device can be used in buried applications without the need to implement additional precautionary measures on the device.

Installation is performed according to regional installation regulations.

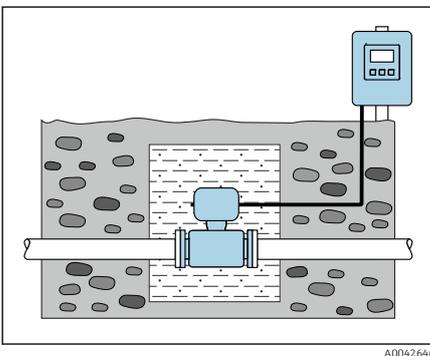

## Environment

---

Ambient temperature range	44
Storage temperature	44
Atmosphere	44
Degree of protection	44
Vibration-resistance and shock-resistance	44
Electromagnetic compatibility (EMC)	45

## Ambient temperature range

<b>Transmitter</b>	-40 to +60 °C (-40 to +140 °F)
<b>Local display</b>	-20 to +60 °C (-4 to +140 °F) The readability of the display may be impaired at temperatures outside the temperature range.
<b>Sensor</b>	<ul style="list-style-type: none"> <li>■ Process connection, carbon steel: -10 to +60 °C (+14 to +140 °F)</li> <li>■ Process connection, stainless steel: -40 to +60 °C (-40 to +140 °F)</li> </ul>
<b>Liner</b>	Do not exceed or fall below the permitted temperature range of the liner → <i>Medium temperature range</i> , 48.   Dependency of ambient temperature on medium temperature → <i>Medium temperature range</i> , 48

## Storage temperature

The storage temperature corresponds to the ambient temperature range of the transmitter and sensor.

## Atmosphere

According to IEC 60529: If a plastic housing is permanently exposed to certain steam and air mixtures, this can damage the housing.

 More Informationen: Endress+Hauser sales organizations.

## Degree of protection

<b>Transmitter</b>	<ul style="list-style-type: none"> <li>■ IP66/67, type 4X enclosure</li> <li>■ Open housing: IP20, type 1 enclosure</li> </ul>	
<b>Sensor</b>	IP66/67, type 4X enclosure	
<b>Optional sensor</b> Order code for "Sensor option", option CA	IP66/67, type 4X enclosure Fully welded, with protective coating as per EN ISO 12944 C5-M	For operation in corrosive environment
Order code for "Sensor option", Option CB, CC	IP68, type 6P enclosure Fully welded, with protective coating as per EN ISO 12944 C5-M and EN 60529	Use of device under water at a maximum water depth of: <ul style="list-style-type: none"> <li>■ 3 m (10 ft): permanent use</li> <li>■ 10 m (30 ft): max. 48 hours</li> </ul>
Order code for "Sensor option", option CE	IP68, type 6P enclosure Fully welded, with protective coating as per EN ISO 12944 Im1/Im2/Im3 and EN 60529	Use of device under water in saline water at a maximum water depth of: <ul style="list-style-type: none"> <li>■ 3 m (10 ft): permanent use</li> <li>■ 10 m (30 ft): max. 48 hours</li> <li>■ Use of device under water at a maximum water depth of: 10 m (30 ft): max. 48 hours</li> <li>■ Use of device in buried applications</li> </ul>

## Vibration-resistance and shock-resistance

### Compact version

<b>Vibration, sinusoidal</b>	2 to 8.4 Hz	3.5 mm peak
<ul style="list-style-type: none"> <li>■ Following IEC 60068-2-6</li> <li>■ 20 cycles per axis</li> </ul>	8.4 to 2 000 Hz	1 g peak
<b>Vibration, broad-band random</b>	10 to 200 Hz	0.003 g <sup>2</sup> /Hz
<ul style="list-style-type: none"> <li>■ Following IEC 60068-2-64</li> <li>■ 120 min per axis</li> </ul>	200 to 2 000 Hz	0.001 g <sup>2</sup> /Hz (1.54 g rms)

<b>Shocks, half-sine</b> <ul style="list-style-type: none"> <li>▪ Following IEC 60068-2-27</li> <li>▪ 3 positive and 3 negative shocks</li> </ul>	6 ms 30 g
---	-----------

**Shock**

Due to rough handling according to IEC 60068-2-31.

**Remote version (sensor)**

<b>Vibration, sinusoidal</b> <ul style="list-style-type: none"> <li>▪ Following IEC 60068-2-6</li> <li>▪ 20 cycles per axis</li> </ul>	2 to 8.4 Hz 8.4 to 2 000 Hz	7.5 mm peak 2 g peak
<b>Vibration, broad-band random</b> <ul style="list-style-type: none"> <li>▪ Following IEC 60068-2-6</li> <li>▪ 120 min per axis</li> </ul>	10 to 200 Hz 200 to 2 000 Hz	0.01 g <sup>2</sup> /Hz 0.003 g <sup>2</sup> /Hz (2.7 g rms)
<b>Shocks, half-sine</b> <ul style="list-style-type: none"> <li>▪ Following IEC 60068-2-6</li> <li>▪ 3 positive and 3 negative shocks</li> </ul>	6 ms 50 g	

**Shock**

Due to rough handling according to IEC 60068-2-31.

**Electromagnetic compatibility (EMC)**

As per IEC/EN 61326 and NAMUR Recommendation NE 21.



For more information: Declaration of Conformity

---

## Process

---

Medium temperature range	48
Conductivity	48
Flow limit	48
Pressure-temperature ratings	49
Pressure tightness	52
Pressure loss	52

### Medium temperature range


The medium temperature range depends on the liner.

Hard rubber	0 to +80 °C (+32 to +176 °F)
Polyurethane	-20 to +50 °C (-4 to +122 °F)
PTFE	<ul style="list-style-type: none"> <li>■ Process connection, carbon steel: -10 to +60 °C (+14 to +140 °F)</li> <li>■ Process connection, stainless steel: -40 to +60 °C (-40 to +140 °F)</li> </ul>

### Conductivity

The necessary minimum conductivity is  $\geq 5 \mu\text{S/cm}$ .

**i** Note that in the case of the remote version, the minimum conductivity depends on the cable length.

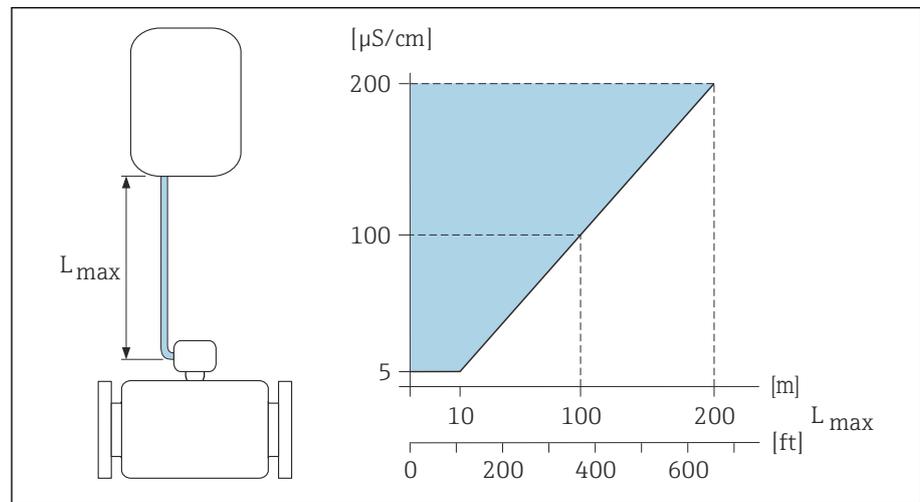

**4** Permitted length of connecting cable

Colored area = permitted range  
 $L_{max}$  = length of connecting cable in [m] ([ft])  
 $[\mu\text{S/cm}]$  = medium conductivity

### Flow limit

Pipe diameter and flow rate determine the nominal diameter of the sensor.

**i** The flow velocity is increased by reducing the sensor nominal diameter.

2 to 3 m/s (6.56 to 9.84 ft/s)	Optimum flow velocity
$v < 2 \text{ m/s}$ (6.56 ft/s)	For abrasive media, e.g. potter's clay, lime milk, ore slurry
$v > 2 \text{ m/s}$ (6.56 ft/s)	For media producing buildup, e.g. wastewater sludge


### Pressure-temperature ratings

Maximum permitted medium pressure as a function of the medium temperature

The data relate to all pressure bearing parts of the device.

#### Fixed flange according to EN 1092-1


Stainless steel (-20 °C (-4 °F))  
Carbon steel (-10 °C (14 °F))

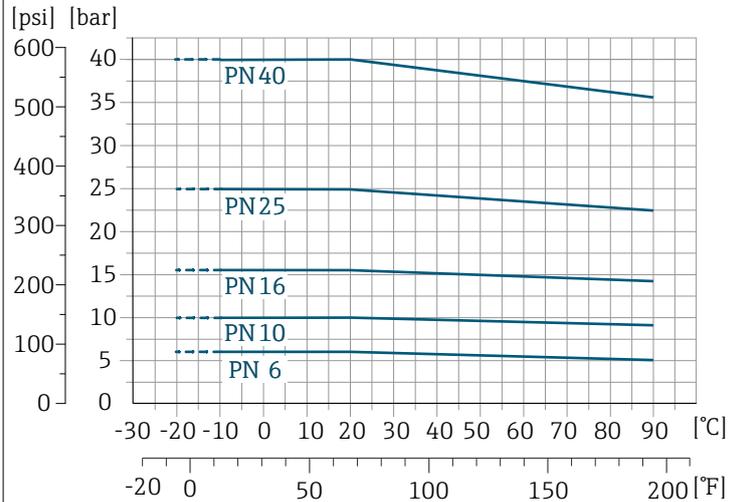

A0038122-EN


#### Fixed flange according to ASME B16.5

Stainless steel

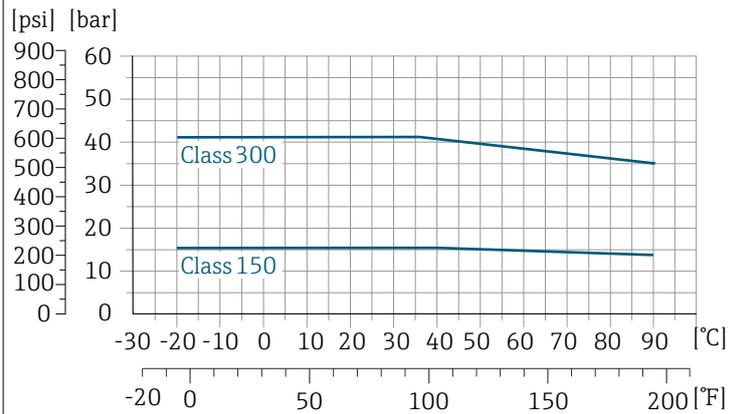

A0038123-EN


Carbon steel

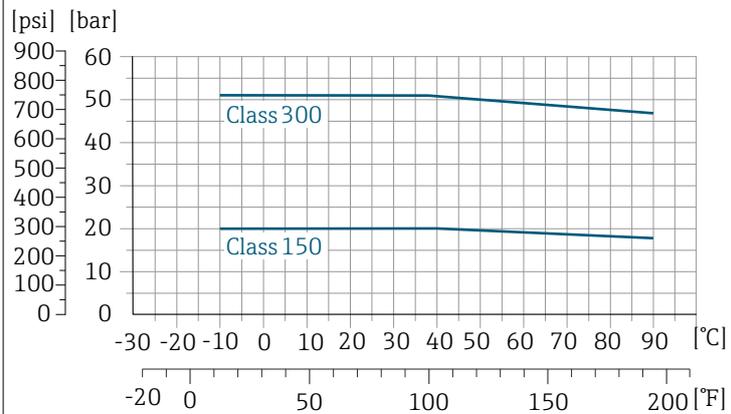

A0038121-EN

**Fixed flange according to JIS B2220**


Stainless steel (-20 °C (-4 °F))  
Carbon steel (-10 °C (14 °F))

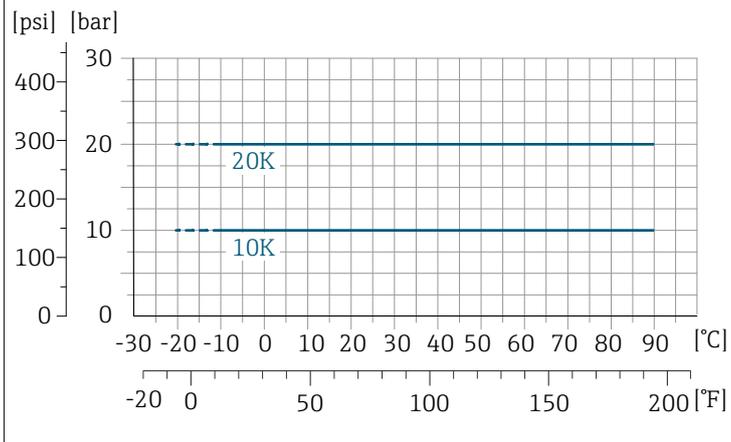

A0038124-EN

**Fixed flange according to AWWA C207**


Carbon steel

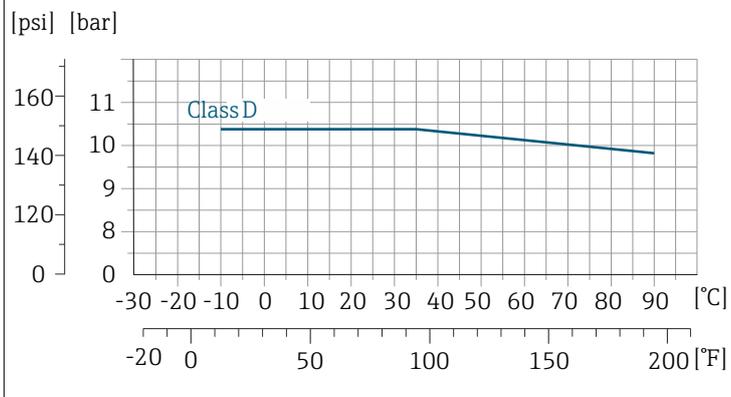

A0038126-EN

**Fixed flange according to AS 2129**


Carbon steel

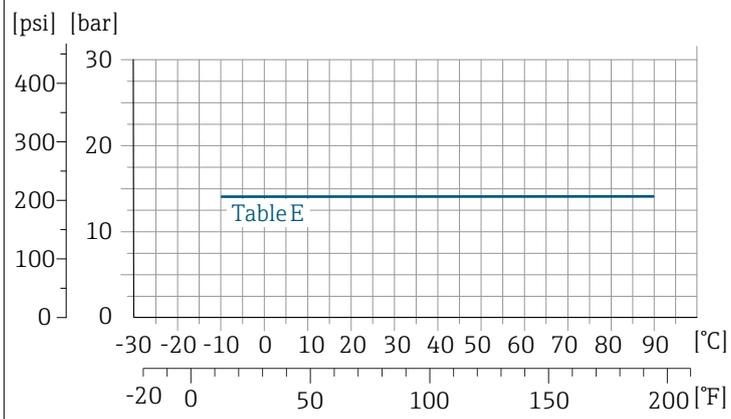

A0038127-EN

**Fixed flange according to AS 4087**


Carbon steel

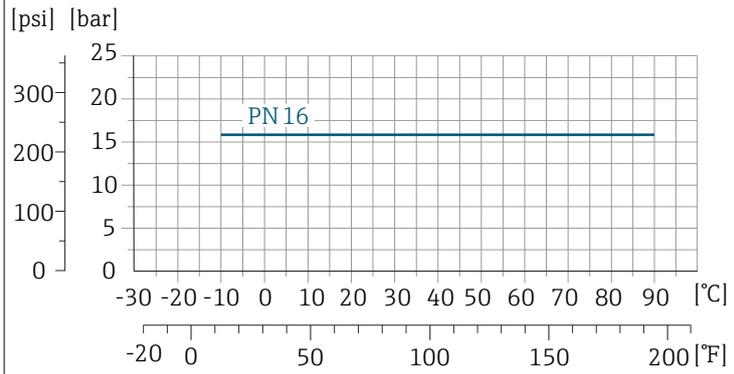

A0038128-EN

**Lap joint flange/lap joint flange, stamped plate according to EN 1092-1 and ASME B16.5**

Stainless steel (-20 °C (-4 °F))  
Carbon steel (-10 °C (14 °F))

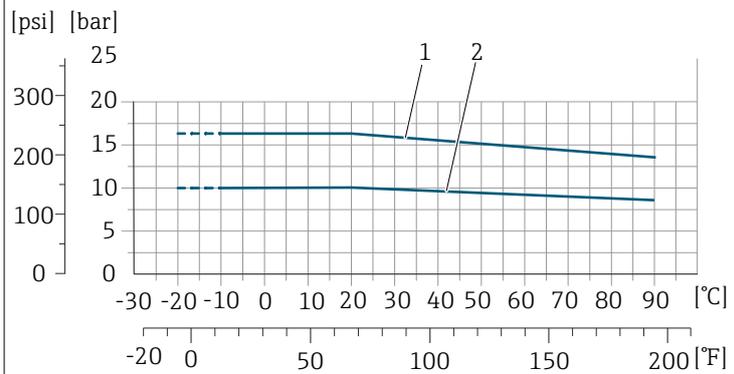

A0038129-EN

- 1 Lap joint flange PN16/Class150
- 2 Lap joint flange, stamped plate PN10, lap joint flange PN10

## Pressure tightness

Limit values for the absolute pressure depending on the liner and medium temperature

PTFE	Nominal diameter		Absolute pressure in [mbar] ([psi])	
	[mm]	[in]	+25 °C (+77 °F)	+90 °C (+194 °F)
	25	1	0 (0)	0 (0)
	40	2	0 (0)	0 (0)
	50	2	0 (0)	0 (0)
	65	2 ½	0 (0)	40 (0.58)
	80	3	0 (0)	40 (0.58)
	100	4	0 (0)	135 (2.0)
	125	5	135 (2.0)	240 (3.5)
	150	6	135 (2.0)	240 (3.5)
	200	8	200 (2.9)	290 (4.2)
	250	10	330 (4.8)	400 (5.8)
	300	12	400 (5.8)	500 (7.3)

Hard rubber	+25 °C (+77 °F)	+50 °C (+122 °F)	+80 °C (+176 °F)
	0 (0)	0 (0)	0 (0)

Polyurethane	+25 °C (+77 °F)	+50 °C (+122 °F)
	0 (0)	0 (0)

## Pressure loss

- No pressure loss: transmitter installed in a pipe with the same nominal diameter.
- Pressure loss information when adapters are used → *Adapters*, 41

## Mechanical construction

---

Weight	54
Measuring pipe specification	58
Materials	59
Fitted electrodes	60
Process connections	60
Surface roughness	60

## Weight

All values refer to devices with flanges with a standard pressure rating.  
Weight data are guideline values. The weight may be lower than indicated depending on the pressure rating and design.

### Transmitter remote version

Aluminum: 2.4 kg (5.3 lbs)

### Sensor remote version

Aluminum sensor connection housing: see the information in the following table.

## Weight in SI units

Order code for "Design", options D, E	Nominal diameter		EN (DIN), AS, JIS		ASME (Class 150)
	[mm]	[in]	Rating	[kg]	[kg]
	25	1	PN 40	10	5
	32	–	PN 40	11	–
	40	1 ½	PN 40	12	7
	50	2	PN 40	13	9
	65	–	PN 16	13	–
	80	3	PN 16	15	14
	100	4	PN 16	18	19
	125	–	PN 16	25	–
	150	6	PN 16	31	33
	200	8	PN 10	52	52
	250	10	PN 10	81	90
	300	12	PN 10	95	129
	350	14	PN 6	106	172
	375	15	PN 6	121	–
	400	16	PN 6	121	203

Order code for "Design", options G	Nominal diameter		EN (DIN) (PN 6)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]
	450	18	161	255
	500	20	156	285
	600	24	208	405
	700	28	304	400
	–	30	–	460
	800	32	357	550
	900	36	485	800
	1000	40	589	900
	–	42	–	1100
	1200	48	850	1400
	–	54	850	2200
	1400	–	1300	–
	–	60	–	2700
	1600	–	1845	–
	–	66	–	3700

Order code for "Design", options G	Nominal diameter		EN (DIN) (PN 6)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]
	1800	72	2 357	4 100
	-	78	2 929	4 600
	2000	-	2 929	-

Order code for "Design", options F	Nominal diameter		EN (DIN) (PN16)	AS (PN 16)	ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[kg]	[kg]	[kg]
	450	18	142	138	191
	500	20	182	186	228
	600	24	227	266	302
	700	28	291	369	266
	-	30	-	447	318
	800	32	353	524	383
	900	36	444	704	470
	1000	40	566	785	587
	-	42	-	-	670
	1200	48	843	1 229	901
	-	54	-	-	1 273
	1400	-	1 204	-	-
	-	60	-	-	1 594
	1600	-	1 845	-	-
	-	66	-	-	2 131
	1800	72	2 357	-	2 568
	-	78	2 929	-	3 113
	2000	-	2 929	-	3 113
	-	84	-	-	3 755
	2200	-	3 422	-	-
	-	90	-	-	4 797
	2400	-	4 094	-	-

**Weight in US units**

All values refer to devices with flanges with a standard pressure rating. Weight data are reference values. They may be lower than indicated depending on the pressure rating and design.

**Transmitter remote version**

- Polycarbonate: 3.1 lb
- Aluminum: 5.3 lb

Order code for "Design", options D, E	Nominal diameter		ASME (Class 150)
	[mm]	[in]	[lb]
	25	1	11
	32	–	–
	40	1 ½	15
	50	2	20
	65	–	–
	80	3	31
	100	4	42
	125	–	–
	150	6	73
	200	8	115
	250	10	198
	300	12	284
	350	14	379
	375	15	–
	400	16	448

Order code for "Design", options F	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	450	18	421
	500	20	503
	600	24	666
	700	28	587
	–	30	701
	800	32	845
	900	36	1036
	1000	40	1294
	–	42	1477
	1200	48	1987
	–	54	2807
	1400	–	–
	–	60	3 515
	1600	–	–
	–	66	4 699
	1800	72	5 662
	–	78	6 864
	2000	–	6 864

Order code for "Design", options F	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	-	84	8280
2200	-	-	-
	-	90	10577
2400	-	-	-

Order code for "Design", options G	Nominal diameter		ASME (Class 150), AWWA (Class D)
	[mm]	[in]	[lb]
	450	18	562
	500	20	628
	600	24	893
	700	28	882
	-	30	1014
	800	32	1213
	900	36	1764
	1000	40	1984
	-	42	2426
	1200	48	3087
	-	54	4851
	1400	-	-
	-	60	5954
	1600	-	-
	-	66	8158
	1800	72	9040
	-	78	10143
	2000	-	-

## Measuring pipe specification

Nominal diameter		Rating				Measuring pipe internal diameter					
		EN (DIN)	ASME AWWA	AS 2129 AS 4087	JIS	Hard rubber		Polyurethane		PTFE	
[mm]	[in]					[mm]	[in]	[mm]	[in]	[mm]	[in]
25	1	PN 40	Class 150	–	20K	–	–	24	0.94	25	0.98
32	–	PN 40	–	–	20K	–	–	32	1.26	34	1.34
40	1 ½	PN 40	Class 150	–	20K	–	–	38	1.50	40	1.57
50	2	PN 40	Class 150	Table E, PN 16	10K	50	1.97	50	1.97	52	2.05
65	–	PN 16	–	–	10K	66	2.60	66	2.60	68	2.68
80	3	PN 16	Class 150	Table E, PN 16	10K	79	3.11	79	3.11	80	3.15
100	4	PN 16	Class 150	Table E, PN 16	10K	102	4.02	102	4.02	104	4.09
125	–	PN 16	–	–	10K	127	5.00	127	5.00	130	5.12
150	6	PN 16	Class 150	Table E, PN 16	10K	156	6.14	156	6.14	156	6.14
200	8	PN 10	Class 150	Table E, PN 16	10K	204	8.03	204	8.03	202	7.95
250	10	PN 10	Class 150	Table E, PN 16	10K	258	10.2	258	10.2	256	10.08
300	12	PN 10	Class 150	Table E, PN 16	10K	309	12.2	309	12.2	306	12.05
350	14	PN 6	Class 150	Table E, PN 16	10K	337	13.3	342	13.5	–	–
375	15	–	–	PN 16	10K	389	15.3	–	–	–	–
400	16	PN 6	Class 150	Table E, PN 16	10K	387	15.2	392	15.4	–	–
450	18	PN 6	Class 150	–	10K	436	17.1	437	17.2	–	–
500	20	PN 6	Class 150	Table E, PN 16	10K	487	19.1	492	19.4	–	–
600	24	PN 6	Class 150	Table E, PN 16	10K	589	23.0	594	23.4	–	–
700	28	PN 6	Class D	Table E, PN 16	10K	688	27.1	692	27.2	–	–
750	30	–	Class D	Table E, PN 16	10K	737	29.1	742	29.2	–	–
800	32	PN 6	Class D	Table E, PN 16	–	788	31.0	794	31.3	–	–
900	36	PN 6	Class D	Table E, PN 16	–	889	35.0	891	35.1	–	–
1000	40	PN 6	Class D	Table E, PN 16	–	991	39.0	994	39.1	–	–
–	42	–	Class D	–	–	1043	41.1	1043	41.1	–	–
1200	48	PN 6	Class D	Table E, PN 16	–	1191	46.9	1197	47.1	–	–
–	54	–	Class D	–	–	1339	52.7	–	–	–	–
1400	–	PN 6	–	–	–	1402	55.2	–	–	–	–
–	60	–	Class D	–	–	1492	58.7	–	–	–	–
1600	–	PN 6	–	–	–	1600	63.0	–	–	–	–
–	66	–	Class D	–	–	1638	64.5	–	–	–	–
1800	72	PN 6	–	–	–	1786	70.3	–	–	–	–
–	78	–	Class D	–	–	1989	78.3	–	–	–	–
2000	–	PN 6	–	–	–	1989	78.3	–	–	–	–
–	84	–	Class D	–	–	2099	84.0	–	–	–	–
2200	–	PN 6	–	–	–	2194	87.8	–	–	–	–
–	90	–	Class D	–	–	2246	89.8	–	–	–	–
2400	–	PN 6	–	–	–	2391	94.1	–	–	–	–

## Materials

<b>Transmitter housing</b>	
Order code for "Housing"	Option A: aluminum, AlSi10Mg, coated
Window material	Glass
<b>Sensor connection housing</b>	
	<ul style="list-style-type: none"> <li>■ Aluminum, AlSi10Mg, coated</li> <li>■ Polycarbonate (in conjunction with order code for "Sensor option", options CA, CB, CC, CD, CE)</li> </ul>
<b>Cable glands and entries</b>	
Cable gland M20×1.5	Plastic
Adapter for cable entry with female thread G ½" or NPT ½"	Nickel-plated brass
<b>Connecting cable for remote version</b>	
	Electrode cable and coil current cable: <ul style="list-style-type: none"> <li>■ PVC cable with copper shield</li> <li>■ Reinforced cable: PVC cable with copper shield and additional steel wire braided jacket</li> </ul>
<b>Sensor housing</b>	
DN 25 to 300 (1 to 12")	<ul style="list-style-type: none"> <li>■ Aluminum half-shell housing: aluminum, AlSi10Mg, coated</li> <li>■ Fully welded carbon steel housing with protective varnish</li> </ul>
DN 350 to 2 400 (14 to 90")	Fully welded carbon steel housing with protective varnish
<b>Measuring pipes</b>	
DN 25 to 600 (1 to 24")	Stainless steel: 1.4301, 1.4306, 304, 304L
DN 700 to 2 400 (28 to 90")	Stainless steel: 1.4301, 304
<b>Liner</b>	
DN 25 to 300 (1 to 12")	PTFE
DN 25 to 1 200 (1 to 48")	Polyurethane
DN 50 to 2 400 (2 to 90")	Hard rubber
<b>Electrodes</b>	
	<ul style="list-style-type: none"> <li>■ Stainless steel: 1.4435 (316L)</li> <li>■ Alloy C22, 2.4602 (UNS N06022)</li> <li>■ Tantalum</li> <li>■ Platinum</li> </ul>
<b>Seals</b>	
	As per DIN EN 1514-1, form IBC

**Process connections**

EN 1092-1 (DIN 2501)	<p>Fixed flange</p> <ul style="list-style-type: none"> <li>▪ Carbon steel: <ul style="list-style-type: none"> <li>▪ DN ≤ 300: S235JRG2, S235JR+N, P245GH, A105, E250C</li> <li>▪ DN 350 to 2 400: P245GH, S235JRG2, A105, E250C</li> <li>▪ DN 350 to 600: P245GH, S235JRG2, A105, E250C</li> </ul> </li> <li>▪ Stainless steel: <ul style="list-style-type: none"> <li>▪ DN ≤ 300: 1.4404, 1.4571, F316L</li> <li>▪ DN 350 to 600: 1.4571, F316L, 1.4404</li> <li>▪ DN 700 to 1 000: 1.4404, F316L</li> </ul> </li> </ul> <p>Lap joint flange</p> <ul style="list-style-type: none"> <li>▪ Carbon steel DN ≤ 300: S235JRG2, A105, E250C</li> <li>▪ Stainless steel DN ≤ 300: 1.4306, 1.4404, 1.4571, F316L</li> </ul> <p>Lap joint flange, stamped plate</p> <ul style="list-style-type: none"> <li>▪ Carbon steel DN ≤ 300: S235JRG2 similar to S235JR+AR or 1.0038</li> <li>▪ Stainless steel DN ≤ 300: 1.4301 similar to 304</li> </ul>
ASME B16.5	<ul style="list-style-type: none"> <li>▪ Carbon steel: A105</li> <li>▪ Stainless steel: F316L</li> </ul>
JIS B2220	<ul style="list-style-type: none"> <li>▪ Carbon steel: A105, A350 LF2</li> <li>▪ Stainless steel: F316L</li> </ul>
AWWA C207	Carbon steel: A105, P265GH, A181 Class 70, E250C, S275JR
AS 2129	Carbon steel: A105, E250C, P235GH, P265GH, S235JRG2
AS 4087	Carbon steel: A105, P265GH, S275JR

**Accessories**

Protective cover	Stainless steel, 1.4404 (316L)
Pipe mounting set	Stainless steel 1.4301 (304)
Wall mounting kit	Stainless steel 1.4301 (304)
Grounding rings	<p>15 to 1 200 mm (½ to 48 in)</p> <ul style="list-style-type: none"> <li>▪ Stainless steel, 1.4435 (316L)</li> <li>▪ Alloy C22, 2.4602 (UNS N06022)</li> </ul>

**Fitted electrodes**

Standard electrodes:

- Measuring electrodes
- Reference electrodes
- Empty pipe detection electrodes

**Process connections**

- EN 1092-1 (DIN 2501)
- ASME B16.5
- JIS B2220
- AS 2129 Table E
- AS 4087 PN 16
- AWWA C207 Class D

**Surface roughness**

All data relate to parts in contact with medium.

Electrodes with 1.4435 (316L); Alloy C22, 2.4602 (UNS N06022); tantalum:  
< 0.5 µm (19.7 µin)

## Dimensions in SI units


<b>Compact version</b>	<b>62</b>
DN 25 to 300 (1 to 12")	62
DN 350 to 900 (14 to 36")	63
DN 1000 to 2400 (40 to 90")	64
<b>Remote version</b>	<b>65</b>
Transmitter remote version	65
Sensor connection housing	65
DN 25 to 300 (1 to 12") aluminum half-shell housing	66
DN 25 to 300 (1 to 12") fully welded housing	67
DN 350 to 900 (14 to 36")	68
DN 1000 to 2400 (40 to 90")	69
<b>Fixed flange</b>	<b>70</b>
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	70
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16	71
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 25	72
Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 40	73
Flange according to ASME B16.5, Class 150	74
Flange according to ASME B16.5, Class 300	75
Flange according to JIS B2220, 10K	76
Flange according to JIS B2220, 20K	77
Flange according to AWWA, Class D	78
Flange according to AS 2129, Tab. E	79
Flange according to AS 4087, PN 16	80
<b>Lap joint flange</b>	<b>81</b>
Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	81
Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16	82
Lap joint flange according to ASME B16.5, Class 150	83
<b>Lap joint flange, stamped plate</b>	<b>84</b>
Lap joint flange, stamped plate in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10	84
<b>Accessories</b>	<b>85</b>
Protective cover	85
Ground disks for flanges	85

## Compact version

DN 25 to 300 (1 to 12")

Order code for "Housing", option A "Compact, aluminum, coated"

Sensor with aluminum half-shell housing

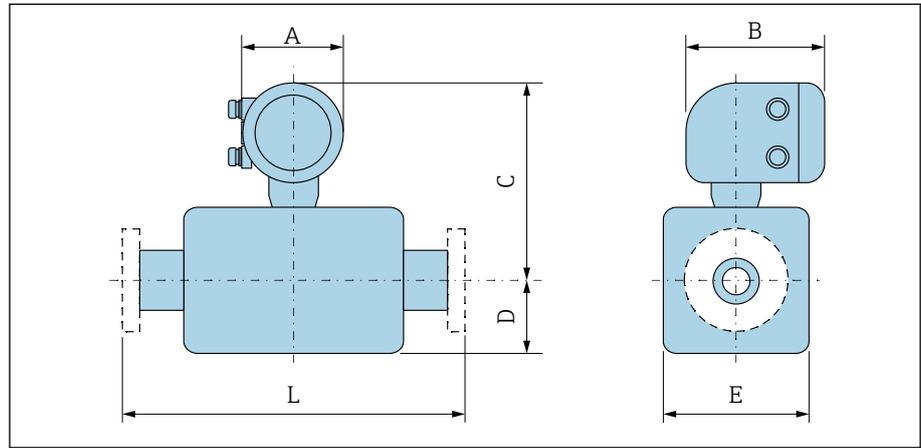

A0042708


DN		Order code for "Design"					
		Options D, E, H, I					
[mm]	[in]	A <sup>1)</sup> [mm]	B [mm]	C <sup>2)</sup> [mm]	D <sup>2)</sup> [mm]	E <sup>2)</sup> [mm]	L [mm]
25	1	139	178	258	84	120	200
32	–	139	178	258	84	120	200
40	1 ½	139	178	258	84	120	200
50	2	139	178	258	84	120	200
65	–	139	178	283	109	180	200
80	3	139	178	283	109	180	200
100	4	139	178	283	109	180	250
125	–	139	178	323	150	260	250
150	6	139	178	323	150	260	300
200	8	139	178	348	180	324	350
250	10	139	178	373	205	400	450
300	12	139	178	398	230	460	500

1) Depending on the cable entry used: values up to + 30 mm

2) Reference values: dependent on the pressure rating, design and order option

**DN 350 to 900 (14 to 36")**

*Order code for "Housing", option A "Compact, aluminum, coated"*

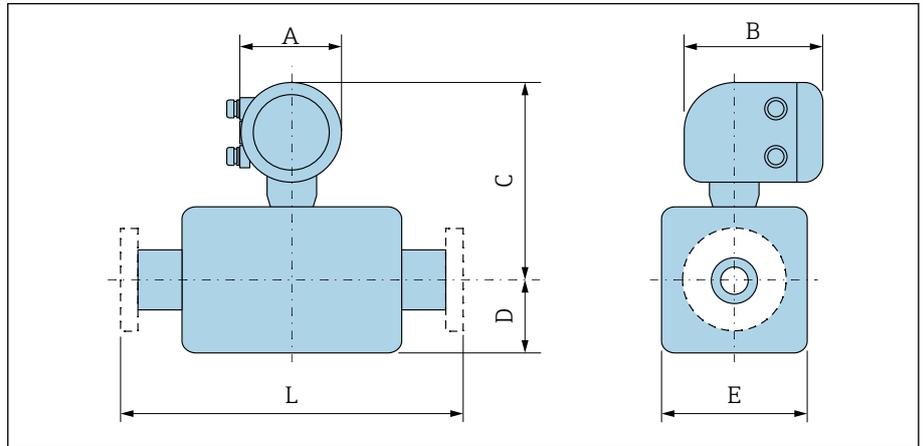


A0042708

DN		A <sup>1)</sup> [mm]	B [mm]	Order code for "Design"						L [mm]	
				Options E, F			Option G				
[mm]	[in]			C <sup>2)</sup> [mm]	D <sup>2)</sup> [mm]	E <sup>2)</sup> [mm]	C <sup>2)</sup> [mm]	D <sup>2)</sup> [mm]	E <sup>2)</sup> [mm]		
350	14	139	178	457	245	490	-	-	-		550
375	15	139	178	483	271	542	-	-	-		600
400	16	139	178	483	271	542	-	-	-		600
450	18	139	178	465	299	598	508	333	666	600 <sup>3)</sup>	650 <sup>4)</sup>
500	20	139	178	490	324	648	534	359	717	600 <sup>3)</sup>	650 <sup>4)</sup>
600	24	139	178	540	365	730	586	411	821	600 <sup>3)</sup>	780 <sup>4)</sup>
700	28	139	178	601	430	860	688	512	1024	700 <sup>3)</sup>	910 <sup>4)</sup>
750	30	139	178	639	467	934	688	512	1024	750 <sup>3)</sup>	975 <sup>4)</sup>
800	32	139	178	658	486	972	709	534	1065	800 <sup>3)</sup>	1040 <sup>4)</sup>
900	36	139	178	708	536	1072	786	610	1218	900 <sup>3)</sup>	1170 <sup>4)</sup>

- 1) Depending on the cable entry used: values up to + 30 mm
- 2) Reference values: dependent on the pressure rating, design and order option
- 3) Order code for "Design", option F "Fixed flange, short installation length"
- 4) Order code for "Design", option G "Fixed flange, long installation length"

## DN 1000 to 2400 (40 to 90")

Order code for "Housing", option A "Compact, aluminum, coated"

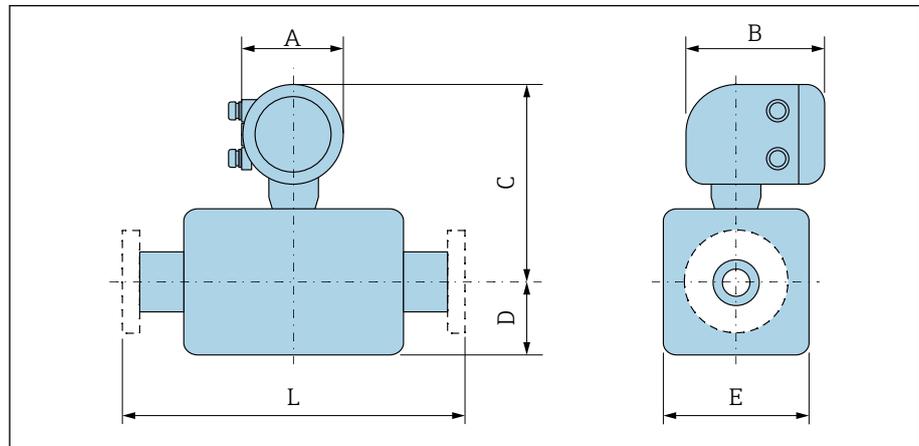


A0042708

DN		A <sup>1)</sup>	B	C <sup>2)</sup>	D <sup>2)</sup>	E <sup>2)</sup>	L	
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	
1000	40	139	178	759	582	1164	1000 <sup>3)</sup>	1300 <sup>4)</sup>
-	42	139	178	795	618	1236	1050 <sup>3)</sup>	1365 <sup>4)</sup>
1200	48	139	178	873	696	1392	1200 <sup>3)</sup>	1560 <sup>4)</sup>
-	54	139	178	986	809	1617	1350 <sup>3)</sup>	1755 <sup>4)</sup>
1400	-	139	178	986	809	1617	1400 <sup>3)</sup>	1820 <sup>4)</sup>
-	60	139	178	1086	909	1817	1500 <sup>3)</sup>	1950 <sup>4)</sup>
1600	-	139	178	1086	909	1817	1600 <sup>3)</sup>	2080 <sup>4)</sup>
-	66	139	178	1137	960	1919	1650 <sup>3)</sup>	2145 <sup>4)</sup>
1800	72	139	178	1193	1016	2032	1800 <sup>3)</sup>	2340 <sup>4)</sup>
-	78	139	178	1305	1127	2254	2000 <sup>3)</sup>	2600 <sup>4)</sup>
2000	-	139	178	1305	1127	2254	2000 <sup>3)</sup>	2600 <sup>4)</sup>
-	84	139	178	1405	1227	2454	2150 <sup>3)</sup>	
2200	-	139	178	1405	1227	2454	2200 <sup>3)</sup>	
-	90	139	178	1510	1227	2664	2300 <sup>3)</sup>	
2400	-	139	178	1510	1332	2664	2400 <sup>3)</sup>	

- 1) Depending on the cable entry used: values up to + 30 mm
- 2) Reference values: dependent on the pressure rating, design and order option
- 3) Order code for "Design", option F "Fixed flange, short installation length"
- 4) Order code for "Design", option G "Fixed flange, long installation length"

## Remote version

### Transmitter remote version

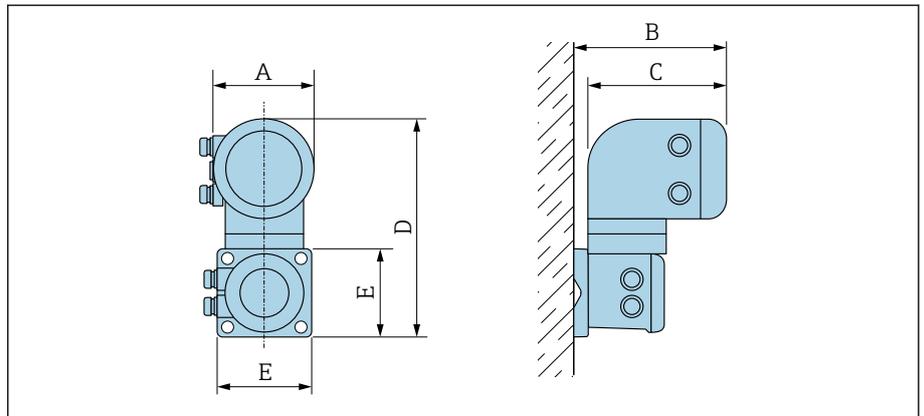


A0042715

Order code for "Housing"	A <sup>1)</sup> [mm]	B [mm]	C [mm]	D [mm]	E [mm]
Option P "Remote, aluminum, coated"	139	185	178	309	130

1) Depending on the cable entry used: values up to + 30 mm

### Sensor connection housing

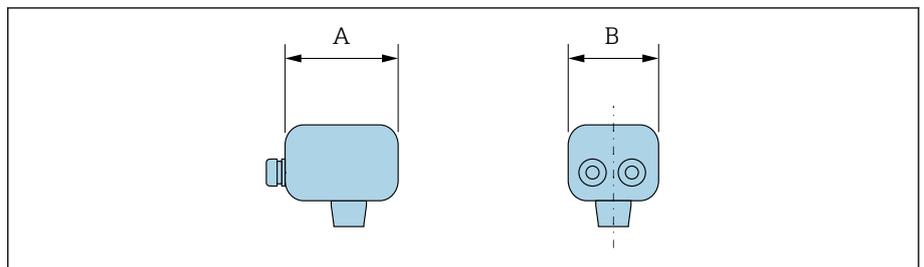

A0042716

Housing material	A <sup>1)</sup> [mm]	B [mm]
Polycarbonate plastic <sup>2)</sup>	113	112
Aluminum, coated	148	136


1) Depending on the cable entry used: values up to + 30 mm

2) In conjunction with order code for "Sensor option", options CA, CB, CC, CD, CE

**DN 25 to 300 (1 to 12") aluminum half-shell housing**

Sensor with aluminum half-shell housing.

Sensor connection housing: aluminum, AlSi10Mg, coated

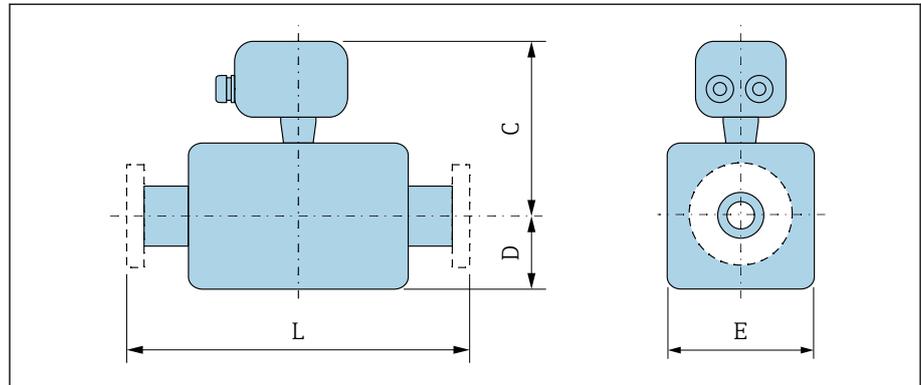


A0041519

DN		Order code for "Design"			
		Options D, E, H, I			
[mm]	[in]	C <sup>1)</sup> [mm]	D [mm]	E [mm]	L [mm]
25	1	197	84	120	200
32	-	197	84	120	200
40	1 ½	197	84	120	200
50	2	197	84	120	200
65	-	222	109	180	200
80	3	222	109	180	200
100	4	222	109	180	250
125	-	262	150	260	250
150	6	262	150	260	300
200	8	287	180	324	350
250	10	312	205	400	450
300	12	337	230	460	500

1) Reference values: dependent on the pressure rating, design and order option

**DN 25 to 300 (1 to 12") fully welded housing**

Sensor with fully welded carbon steel housing:  
 Order code for "Sensor option", options CA, CB, CC, CD, CE

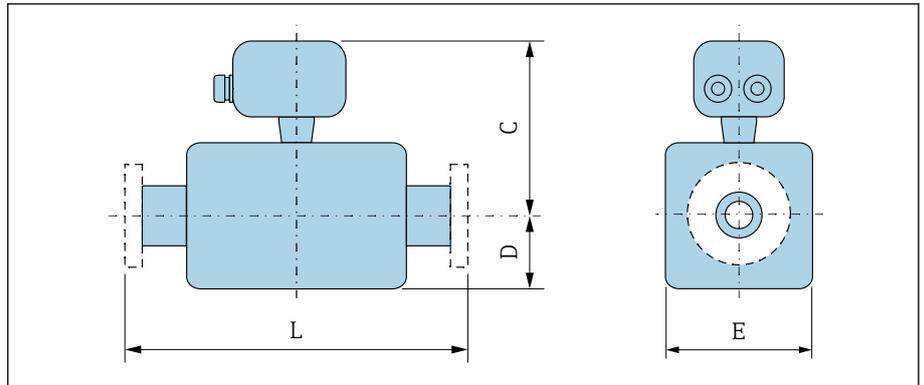


A0041519

DN		Order code for "Design"			
		Options A, E			
[mm]	[in]	C <sup>1)</sup> [mm]	D <sup>1)</sup> [mm]	E <sup>1)</sup> [mm]	L [mm]
25	1	189	70	140	200
32	-	189	70	140	200
40	1 ½	189	70	140	200
50	2	189	70	140	200
65	-	202	82	165	200
80	3	207	87	175	200
100	4	219	100	200	250
125	-	232	113	226	250
150	6	254	134	269	300
200	8	279	160	320	350
250	10	313	193	387	450
300	12	338	218	437	500

1) Reference values: dependent on the pressure rating, design and order option

## DN 350 to 900 (14 to 36")

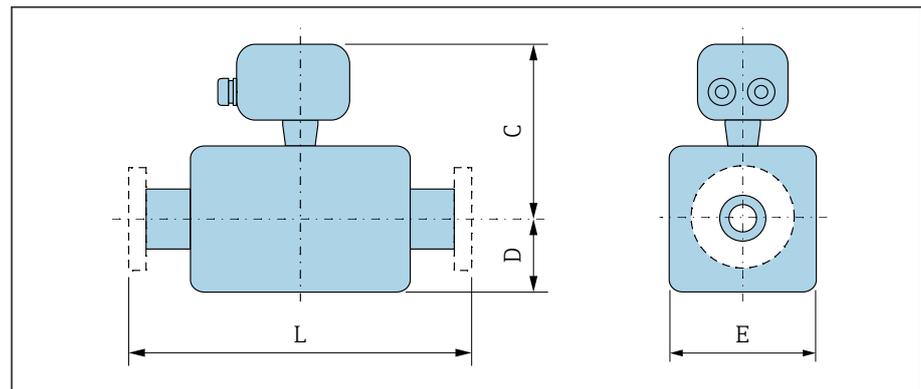


A0041519

DN		Order code for "Design"							L	
		Options E, F			Option G					
[mm]	[in]	C <sup>1)</sup> [mm]	D <sup>1)</sup> [mm]	E <sup>1)</sup> [mm]	C <sup>1)</sup> [mm]	D <sup>1)</sup> [mm]	E <sup>1)</sup> [mm]			
350	14	395	245	490	-	-	-	550		
375	15	421	271	542	-	-	-	600		
400	16	421	271	542	-	-	-	600		
450	18	403	299	598	446	333	666	600 <sup>2)</sup>	650 <sup>3)</sup>	
500	20	428	324	648	472	359	717	600 <sup>2)</sup>	650 <sup>3)</sup>	
600	24	478	365	730	524	411	821	600 <sup>2)</sup>	780 <sup>3)</sup>	
700	28	539	430	860	626	512	1024	700 <sup>2)</sup>	910 <sup>3)</sup>	
750	30	577	467	934	626	512	1024	750 <sup>2)</sup>	975 <sup>3)</sup>	
800	32	596	486	972	647	534	1065	800 <sup>2)</sup>	1040 <sup>3)</sup>	
900	36	646	536	1072	724	610	1218	900 <sup>2)</sup>	1170 <sup>3)</sup>	

- 1) Reference values: dependent on the pressure rating, design and order option
- 2) Order code for "Design", option F "Fixed flange, short installation length"
- 3) Order code for "Design", option G "Fixed flange, long installation length"

DN 1000 to 2400 (40 to 90")

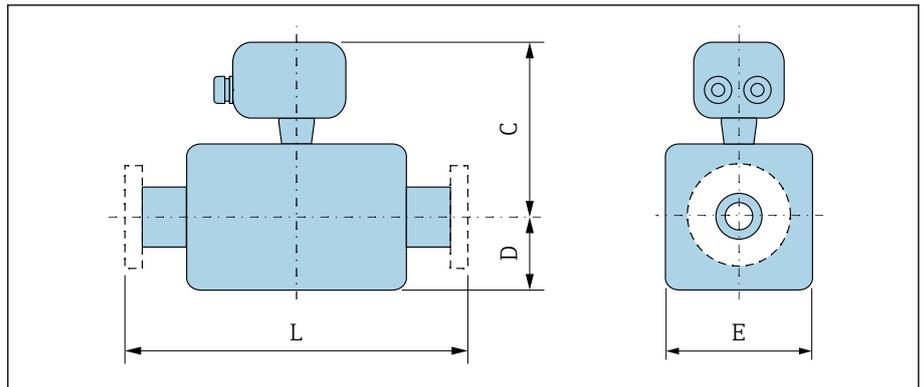

A0041519

DN		C <sup>1)</sup>	D <sup>1)</sup>	E <sup>1)</sup>	L	
[mm]	[in]	[mm]	[mm]	[mm]	[mm]	
1000	40	698	582	1164	1000 <sup>2)</sup>	1300 <sup>3)</sup>
-	42	734	618	1236	1050 <sup>2)</sup>	1365 <sup>3)</sup>
1200	48	812	696	1392	1200 <sup>2)</sup>	1560 <sup>3)</sup>
-	54	925	809	1617	1350 <sup>2)</sup>	1755 <sup>3)</sup>
1400	-	925	809	1617	1400 <sup>2)</sup>	1820 <sup>3)</sup>
-	60	1025	909	1817	1500 <sup>2)</sup>	1950 <sup>3)</sup>
1600	-	1025	909	1817	1600 <sup>2)</sup>	2080 <sup>3)</sup>
-	66	1076	960	1919	1650 <sup>2)</sup>	2145 <sup>3)</sup>
1800	72	1132	1016	2032	1800 <sup>2)</sup>	2340 <sup>3)</sup>
-	78	1244	1127	2254	2000 <sup>2)</sup>	2600 <sup>3)</sup>
2000	-	1244	1127	2254	2000 <sup>2)</sup>	2600 <sup>3)</sup>
-	84	1344	1227	2454	2150 <sup>2)</sup>	
2200	-	1344	1227	2454	2200 <sup>2)</sup>	
-	90	1449	1227	2664	2300 <sup>2)</sup>	
2400	-	1449	1332	2664	2400 <sup>2)</sup>	

- 1) Reference values: dependent on the pressure rating, design and order option
- 2) Order code for "Design", option F "Fixed flange, short installation length"
- 3) Order code for "Design", option G "Fixed flange, long installation length"


## Fixed flange

### Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D2K
- Stainless steel: order code for "Process connection", option D2S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner →  58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
200	340	295	8 × Ø22	26
250	395	350	12 × Ø22	28
300	445	400	12 × Ø22	28
350	505	460	16 × Ø22	26
400	565	515	16 × Ø26	26
450	615	565	20 × Ø26	26
500	670	620	20 × Ø26	28
600	780	725	20 × Ø30	30
700	895	840	24 × Ø30	35
800	1015	950	24 × Ø33	38
900	1115	1050	28 × Ø33	38
1000	1230	1160	28 × Ø36	44
1200	1455	1380	32 × Ø39	55
1400	1675	1590	36 × Ø42	65
1600	1915	1820	40 × Ø48	75
1800	2115	2020	44 × Ø48	85
2000	2325	2230	48 × Ø48	90
2200	2550	2440	52 × Ø56	100
2400	2760	2650	56 × Ø56	110

**Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16**

- Carbon steel: order code for "Process connection", option D3K
- Stainless steel: order code for "Process connection", option D3S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
65	185	145	8 × Ø18	20
80	200	160	8 × Ø18	20
100	220	180	8 × Ø18	22
125	250	210	8 × Ø18	24
150	285	240	8 × Ø22	24
200	340	295	12 × Ø22	26
250	405	355	12 × Ø26	32
300	460	410	12 × Ø26	32
350	520	470	16 × Ø26	30
400	580	525	16 × Ø30	32
450	640	585	20 × Ø30	34
500	715	650	20 × Ø33	36
600	840	770	20 × Ø36	40
700	910	840	24 × Ø36	40
800	1025	950	24 × Ø39	41
900	1125	1050	28 × Ø39	48
1000	1255	1170	28 × Ø42	59
1200	1485	1390	32 × Ø48	78
1400	1685	1590	36 × Ø48	84
1600	1930	1820	40 × Ø56	102
1800	2130	2020	44 × Ø56	110
2000	2345	2230	48 × Ø62	124

**Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 25**

- Carbon steel: order code for "Process connection", option D4K
- Stainless steel: order code for "Process connection", option D4S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner →  58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
200	360	310	12 × Ø26	32
250	425	370	12 × Ø30	36
300	485	430	16 × Ø30	40
350	555	490	16 × Ø33	38
400	620	550	16 × Ø36	40
450	670	600	20 × Ø36	46
500	730	660	20 × Ø36	48
600	845	770	20 × Ø39	48
700	960	875	24 × Ø42	50
800	1085	990	24 × Ø48	53
900	1185	1090	28 × Ø48	57
1000	1320	1210	28 × Ø56	63

**Flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 40**

- Carbon steel: order code for "Process connection", option D5K
- Stainless steel: order code for "Process connection", option D5S

Surface roughness: EN 1092-1 Form B1 (DIN 2526 Form C), Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 58.



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	115	85	4 × Ø14	16
32	140	100	4 × Ø18	18
40	150	110	4 × Ø18	18
50	165	125	4 × Ø18	20
65	185	145	8 × Ø18	24
80	200	160	8 × Ø18	26
100	235	190	8 × Ø22	26
125	270	220	8 × Ø26	28
150	300	250	8 × Ø26	30

**Flange according to ASME B16.5, Class 150**

- Carbon steel: order code for "Process connection", option A1K
- Stainless steel: order code for "Process connection", option A1S

Surface roughness: Ra 6.3 to 12.5  $\mu\text{m}$

E: Internal diameter depends on the liner →  58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	108	79.2	4 × Ø16	12.6
40	127	98.6	4 × Ø16	15.9
50	152.4	120.7	4 × Ø19.1	17.5
80	190.5	152.4	4 × Ø19.1	22.3
100	228.6	190.5	8 × Ø19.1	22.3
150	279.4	241.3	8 × Ø22.4	23.8
200	342.9	298.5	8 × Ø22.4	26.8
250	406.4	362	12 × Ø25.4	29.6
300	482.6	431.8	12 × Ø25.4	30.2
350	535	476.3	12 × Ø28.6	35.4
400	595	539.8	16 × Ø28.6	37
450	635	577.9	16 × Ø31.8	40.1
500	700	635	20 × Ø31.8	43.3
600	815	749.3	20 × Ø34.9	48.1

**Flange according to ASME B16.5, Class 300**

- Carbon steel: order code for "Process connection", option A2K
- Stainless steel: order code for "Process connection", option A2S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner →  58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	123.9	88.9	4 × Ø19.1	15.9
40	155.4	114.3	4 × Ø22.4	19
50	165.1	127	8 × Ø19.1	20.8
80	209.6	168.1	8 × Ø22.4	26.8
100	254	200.2	8 × Ø22.4	30.2
150	317.5	269.7	12 × Ø22.4	35

**Flange according to JIS B2220, 10K**

- Carbon steel: order code for "Process connection", option N3K
- Stainless steel: order code for "Process connection", option N3S

Surface roughness: Ra 6.3 to 12.5  $\mu\text{m}$

E: Internal diameter depends on the liner →  58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
50	155	120	4 × Ø19	16
65	175	140	4 × Ø19	18
80	185	150	8 × Ø19	18
100	210	175	8 × Ø19	18
125	250	210	8 × Ø23	20
150	280	240	8 × Ø23	22
200	330	290	12 × Ø23	22
250	400	355	12 × Ø25	24
300	445	400	16 × Ø25	24

**Flange according to JIS B2220, 20K**

- Carbon steel: order code for "Process connection", option N4K
- Stainless steel: order code for "Process connection", option N4S

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 58



A0041915


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
25	125	90	4 × Ø19	16
32	135	100	4 × Ø19	18
40	140	105	4 × Ø19	18
50	155	120	8 × Ø19	18
65	175	140	8 × Ø19	20
80	200	160	8 × Ø23	22
100	225	185	8 × Ø23	24
125	270	225	8 × Ø25	26
150	305	260	12 × Ø25	28
200	350	305	12 × Ø25	30
250	430	380	12 × Ø27	34
300	480	430	16 × Ø27	36

**Flange according to AWWA, Class D**

Order code for "Process connection", option W1K

Surface roughness: Ra 6.3 to 12.5  $\mu\text{m}$ 

E: Internal diameter depends on the liner → 58



A0041915


	DN		A [mm]	B [mm]	C [mm]	D [mm]
	[mm]	[in]				
	700	28	927	863.6	28 × Ø35	33.4
	750	30	984	914.4	28 × Ø35	35
	800	32	1060	977.9	28 × Ø42	38.1
	900	36	1168	1085.9	32 × Ø42	41.3
	1000	40	1289	1200.2	36 × Ø42	41.3
	-	42	1346	1257.3	36 × Ø42	44.5
	1200	48	1511	1422.4	44 × Ø42	47.7
	-	54	1683	1593.9	44 × Ø48	54
	-	60	1855	1759	52 × Ø48	57.2
	-	66	2032	1930.4	52 × Ø48	63.5
	1800	72	2197	2095.5	60 × Ø48	66.7
	-	78	2362	2260.6	64 × Ø54	69.9
	-	84	2535	2425.7	64 × Ø54	73.1
	-	90	2705	2717.8	68 × Ø60	76.2

**Flange according to AS 2129, Tab. E**

Order code for "Process connection", option M2K

Surface roughness: Ra 6.3 to 12.5 µm

E: Internal diameter depends on the liner → 58.




A0041915

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
80	185	146	4 × Ø18	12
100	215	178	8 × Ø18	13
150	280	235	8 × Ø22	17
200	335	292	8 × Ø22	19
250	405	356	12 × Ø22	22
300	455	406	12 × Ø26	25
350	525	470	12 × Ø26	30
400	580	521	12 × Ø26	32
450	640	584	16 × Ø26	35
500	705	641	16 × Ø26	38
600	825	756	16 × Ø33	48
700	910	845	20 × Ø33	51
750	995	927	20 × Ø36	54
800	1060	984	20 × Ø36	54
900	1175	1092	24 × Ø36	64
1000	1255	1175	24 × Ø39	67
1200	1490	1410	32 × Ø39	79

**Flange according to AS 4087, PN 16**

Order code for "Process connection", option M3K

Surface roughness: Ra 6.3 to 12.5  $\mu\text{m}$ E: Internal diameter depends on the liner →  58

A0041915

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]
80	185	146	4 × Ø18	12
100	215	178	4 × Ø18	13
150	280	235	8 × Ø18	13
200	335	292	8 × Ø18	19
250	405	356	8 × Ø22	19
300	455	406	12 × Ø22	23
350	525	470	12 × Ø26	30
375	550	495	12 × Ø26	30
400	580	521	12 × Ø26	32
450	640	584	12 × Ø26	30
500	705	641	16 × Ø26	38
600	825	756	16 × Ø30	48
700	910	845	20 × Ø30	56
750	995	927	20 × Ø33	56
800	1060	984	20 × Ø36	56
900	1175	1092	24 × Ø36	66
1000	1255	1175	24 × Ø36	66
1200	1490	1410	32 × Ø36	76

### Lap joint flange


#### Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D22
- Stainless steel: order code for "Process connection", option D24

Surface roughness (flange): Ra 6.3 to 12.5 µm

F: Internal diameter depends on the liner → 58

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
200	340	295	8 × Ø22	24	264
250	395	350	12 × Ø22	26	317
300	445	400	12 × Ø22	26	367




A0042254

**Lap joint flange in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 16**

- Carbon steel: order code for "Process connection", option D32
- Stainless steel: order code for "Process connection", option D34

Surface roughness (flange): Ra 6.3 to 12.5  $\mu\text{m}$

F: Internal diameter depends on the liner →  58



A0042254


DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	115	85	4 × Ø14	16	49
32	140	100	4 × Ø18	18	65
40	150	110	4 × Ø18	18	71
50	165	125	4 × Ø18	20	88
65	185	145	8 × Ø18	20	103
80	200	160	8 × Ø18	20	120
100	220	180	8 × Ø18	22	148
125	250	210	8 × Ø18	22	177
150	285	240	8 × Ø22	24	209
200	340	295	12 × Ø22	26	264
250	405	355	12 × Ø26	29	317
300	460	410	12 × Ø26	32	367

**Lap joint flange according to ASME B16.5, Class 150**

- Carbon steel: order code for "Process connection", option A12
- Stainless steel: order code for "Process connection", option A14

Surface roughness (flange): Ra 6.3 to 12.5 µm

F: Internal diameter depends on the liner → 58



A0042254

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	110	80	4 × Ø16	14	49
40	125	98	4 × Ø16	17.5	71
50	150	121	4 × Ø19	19	88
80	190	152	4 × Ø19	24	120
100	230	190	8 × Ø19	24	148
150	280	241	8 × Ø23	25	209
200	345	298	8 × Ø23	29	264
250	405	362	12 × Ø25	30	317
300	485	432	12 × Ø25	32	378


## Lap joint flange, stamped plate

### Lap joint flange, stamped plate in accordance with EN 1092-1 (DIN 2501 / DIN 2512N): PN 10

- Carbon steel: order code for "Process connection", option D21
- Stainless steel: order code for "Process connection", option D23

Surface roughness (flange): Ra 6.3 to 12.5  $\mu\text{m}$

F: Internal diameter depends on the liner → 58




A0042254

DN [mm]	A [mm]	B [mm]	C [mm]	D [mm]	E [mm]
25	115	85	4 x Ø13.5	16.5	49
32	140	100	4 x Ø17.5	17	65
40	150	110	4 x Ø17.5	16.5	71
50	165	125	4 x Ø17.5	18.5	88
65	185	145	4 x Ø17.5	20	103
80	200	160	8 x Ø17.5	23.5	120
100	220	180	8 x Ø17.5	24.5	148
125	250	210	8 x Ø17.5	24	177
150	285	240	8 x Ø21.5	25	209
200	340	295	8 x Ø21.5	27.5	264
250	405	350	12 x Ø21.5	30.5	317
300	445	400	12 x Ø21.5	34.5	367

Accessories

Protective cover

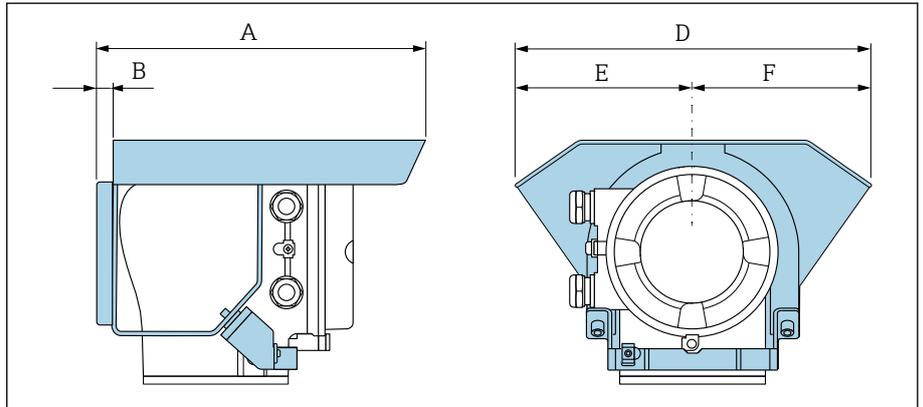

A0042332

A [mm]	B [mm]	D [mm]	E [mm]	F [mm]
257	12	280	140	140


Ground disks for flanges

DN 25 to 300 (1 to 12")		DN	Rating	A	B	C <sup>1)</sup>	D	E	F
		[mm]	[in]	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]
		25	1"	87.5	6.5	2	26	62	77.5
		32	1 ¼"	94.5	6.5	2	35	80	87.5
		40	1 ½"	103	6.5	2	41	82	101
		50	2"	108	6.5	2	52	101	115.5
		65	2 ½"	118	6.5	2	68	121	131.5
		80	3"	135	6.5	2	80	131	154.5
		100	4"	153	6.5	2	104	156	186.5
		125	5"	160	6.5	2	130	187	206.5
		150	6"	184	6.5	2	158	217	256
		200	8"	205	6.5	2	206	267	288
		250	10"	240	6.5	2	260	328	359
	300	12"	PN 10 PN 16 Cl. 150	273	6.5	2	312	375	413

A0042332

- 1) Material thickness
- 2) In the case of DN 25 to 250, ground disks can be used for all the flange standards/pressure ratings which can be supplied in the standard version.


DN		Rating	A	B	C <sup>1)</sup>	D	E	F
[mm]	[in]							
300	12"	PN 25 JIS 10K JIS 20K	268	9	2	310	375	404
350	14"	PN 6 PN 10 PN 16	365	9	2	343	420	479
375	15"	PN 16	395	9	2	393	461	523
400	16"	PN 6 PN 10 PN 16	395	9	2	393	470	542
450	18"	PN 6 PN 10 PN 16	417	9	2	439	525	583
500	20"	PN 6 PN 10 PN 16	460	9	2	493	575	650
600	24"	PN 6 PN 10 PN 16	522	9	2	593	676	766

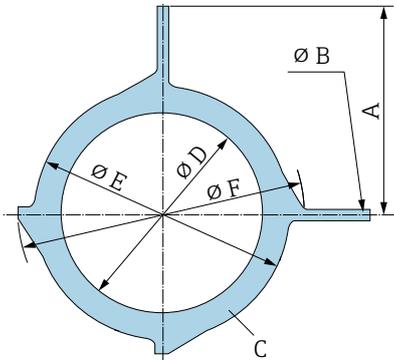

A0042323

1) Material thickness

DN		Rating	A	B	C <sup>1)</sup>	D	E
[mm]	[inch]						
700	28"	PN 6	18.11	6.4	2	697	786
		PN10	18.9			693	813
		PN16	19.29			687	807
		Cl, D	19.45			693	832
750	30"	Cl, D	20.59	6.4	2	743	833
800	32"	PN 6	520	6.4	2	799	893
		PN 10	540			795	920
		PN 16	550			789	914
		Cl, D	561			795	940
900	36"	PN 6	570	6.4	2	897	993
		PN 10	590			893	1020
		PN 16	595			886	1014
		Cl, D	615			893	1048
1000	40"	PN 6	620	6.4	2	999	1093
		PN 10	650			995	1127
		PN 16	660			988	1131
		Cl, D	675			995	1163
-	42"	PN 6	704	6.4	2	1044	1220
1200	48"	PN 6	733	6.4	2	1203	1310
		PN 10	760			1196	1344
		PN 16	786			1196	1385
		Cl, D	775			1188	1345

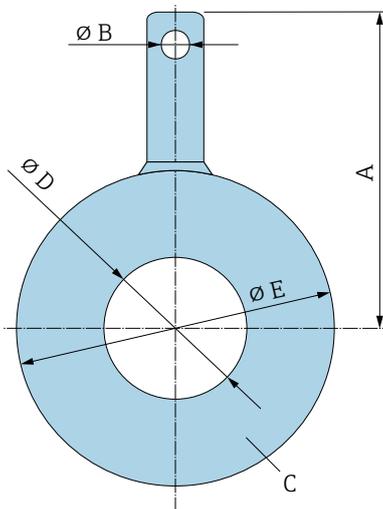

A0042324

1) Material thickness

## Dimensions in US units

---


<b>Compact version</b>	<b>88</b>
DN 25 to 300 (1 to 12")	88
DN 350 to 900 (14 to 36")	89
DN 1000 to 2400 (40 to 90")	90
<b>Remote version</b>	<b>91</b>
Transmitter remote version	91
Sensor connection housing	91
DN 25 to 300 (1 to 12") aluminum half-shell housing	92
DN 25 to 300 (1 to 12") fully welded housing	93
DN 350 to 900 (14 to 36")	94
DN 1000 to 2400 (40 to 90")	95
<b>Fixed flange</b>	<b>96</b>
Flange according to ASME B16.5, Class 150	96
Flange according to ASME B16.5, Class 300	96
Flange according to AWWA, Cl. D	97
<b>Lap joint flange</b>	<b>98</b>
Lap joint flange according to ASME B16.5, Class 150	98
<b>Accessories</b>	<b>99</b>
Protective cover	99
Ground disks for flanges	99

## Compact version

DN 25 to 300 (1 to 12")

Order code for "Housing", option A "Compact, aluminum, coated"

Sensor with aluminum half-shell housing

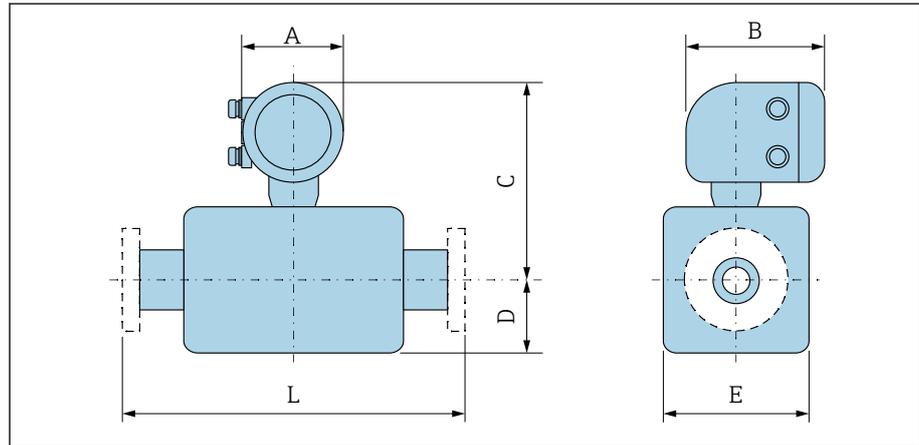


A0042708

DN		A <sup>1)</sup> [in]	B [in]	Order code for "Design"			L [in]
[mm]	[in]			Options D, E, H, I			
				C <sup>2)</sup> [in]	D <sup>2)</sup> [in]	E <sup>2)</sup> [in]	
25	1	5.47	7.01	10.16	3.31	4.72	7.87
32	-	5.47	7.01	10.16	3.31	4.72	7.87
40	1 ½	5.47	7.01	10.16	3.31	4.72	7.87
50	2	5.47	7.01	10.16	3.31	4.72	7.87
65	-	5.47	7.01	11.14	4.29	7.09	7.87
80	3	5.47	7.01	11.14	4.29	7.09	7.87
100	4	5.47	7.01	11.14	4.29	7.09	9.84
125	-	5.47	7.01	12.72	5.91	10.24	9.84
150	6	5.47	7.01	12.72	5.91	10.24	11.81
200	8	5.47	7.01	13.7	7.09	12.76	13.78
250	10	5.47	7.01	14.69	8.07	15.75	17.72
300	12	5.47	7.01	15.67	9.06	18.11	19.69

- 1) Depending on the cable entry used: values up to +1.18 in  
 2) Reference values: dependent on the pressure rating, design and order option

DN 350 to 900 (14 to 36")

Order code for "Housing", option A "Compact, aluminum, coated"

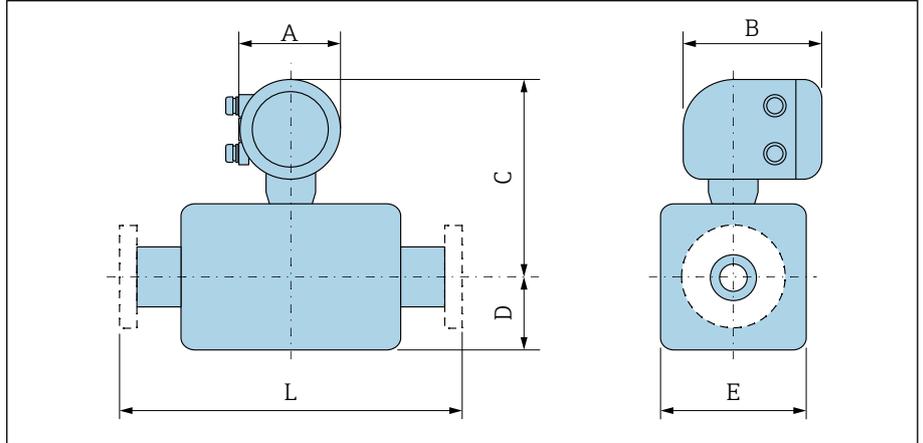


A0042708

DN		A <sup>1)</sup> [in]	B [in]	Order code for "Design"						L [in]	
				Options E, F			Option G				
[mm]	[in]			C <sup>2)</sup> [in]	D <sup>2)</sup> [in]	E <sup>2)</sup> [in]	C <sup>2)</sup> [in]	D <sup>2)</sup> [in]	E <sup>2)</sup> [in]		
350	14	5.47	7.01	17.99	9.65	19.29	-	-	-	21.65	
375	15	5.47	7.01	19.02	10.67	21.34	-	-	-	23.62	
400	16	5.47	7.01	19.02	10.67	21.34	-	-	-	23.62	
450	18	5.47	7.01	18.31	11.77	23.54	20	13.11	26.22	23.62 <sup>3)</sup>	25.59 <sup>4)</sup>
500	20	5.47	7.01	19.29	12.76	25.51	21.02	14.13	28.23	23.62	25.59
600	24	5.47	7.01	21.26	14.37	28.74	23.07	16.18	32.32	23.62	30.71
700	28	5.47	7.01	23.66	16.93	33.86	27.09	20.16	40.31	27.56	35.83
750	30	5.47	7.01	25.16	18.39	36.77	27.09	20.16	40.31	29.53	38.39
800	32	5.47	7.01	25.91	19.13	38.27	27.91	21.02	41.93	31.5	40.94
900	36	5.47	7.01	27.87	21.1	42.2	30.94	24.02	47.95	35.43	46.06

- 1) Depending on the cable entry used: values up to +1.18 in
- 2) Reference values: dependent on the pressure rating, design and order option
- 3) Order code for "Design", option F "Fixed flange, short installation length"
- 4) Order code for "Design", option G "Fixed flange, long installation length"

## DN 1000 to 2400 (40 to 90")

Order code for "Housing", option A "Compact, aluminum, coated"

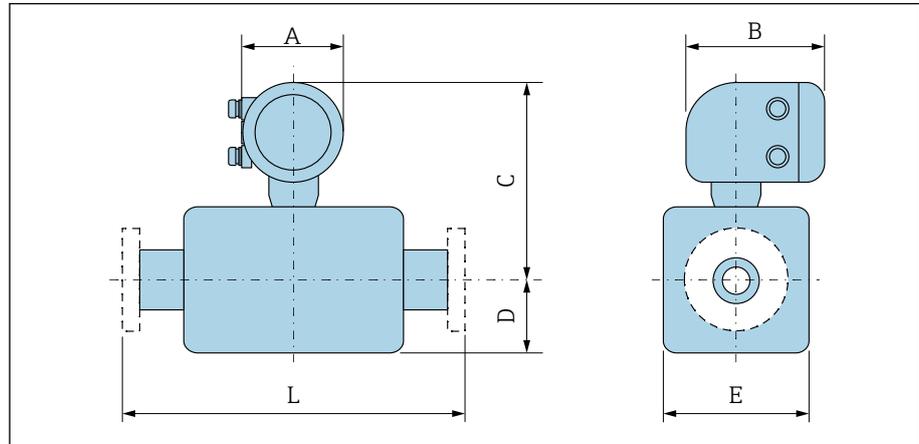


A0042708

DN		A <sup>1)</sup>	B	C <sup>2)</sup>	D <sup>2)</sup>	E <sup>2)</sup>	L	
[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	
1000	40	5.47	7.01	29.88	22.91	45.83	39.37 <sup>3)</sup>	51.18 <sup>4)</sup>
-	42	5.47	7.01	31.3	24.33	48.66	41.34	53.74
1200	48	5.47	7.01	34.37	27.4	54.8	47.24	61.42
-	54	5.47	7.01	38.82	31.85	63.66	53.15	69.09
1400	-	5.47	7.01	38.82	31.85	63.66	55.12	71.65
-	60	5.47	7.01	42.76	35.79	71.54	59.06	76.77
1600	-	5.47	7.01	42.76	35.79	71.54	62.99	81.89
-	66	5.47	7.01	44.76	37.8	75.55	64.96	84.45
1800	72	5.47	7.01	46.97	40	80	70.87	92.13
-	78	5.47	7.01	51.38	44.37	88.74	78.74	102.36
2000	-	5.47	7.01	51.38	44.37	88.74	78.74	102.36
-	84	5.47	7.01	55.31	48.31	96.61	84.65	
2200	-	5.47	7.01	55.31	48.31	96.61	86.61	
-	90	5.47	7.01	59.45	48.31	104.88	90.55	
2400	-	5.47	7.01	59.45	52.44	104.88	94.49	

- 1) Depending on the cable entry used: values up to +1.18 in
- 2) Reference values: dependent on the pressure rating, design and order option
- 3) Order code for "Design", option F "Fixed flange, short installation length"
- 4) Order code for "Design", option G "Fixed flange, long installation length"

### Remote version

#### Transmitter remote version

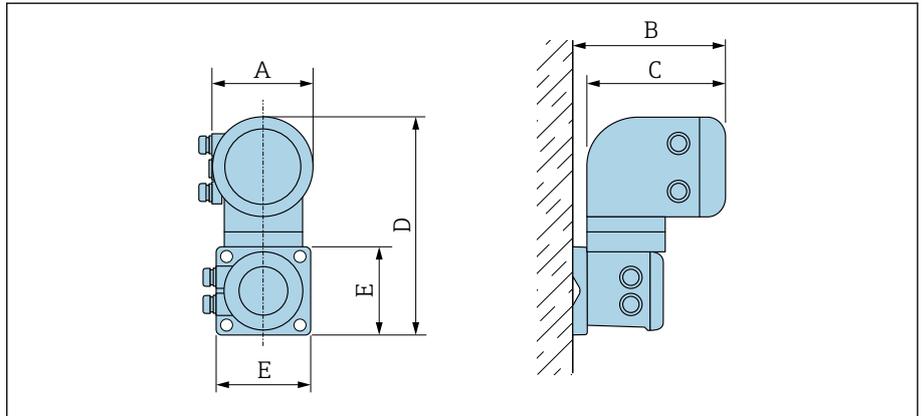


A0042715

Order code for "Housing"	A <sup>1)</sup> [in]	B [in]	C [in]	D [in]	E [in]
Option P "Remote, aluminum, coated"	5.47	7.28	7.01	12.17	5.12

1) Depending on the cable entry used: values up to +1.18 in

#### Sensor connection housing

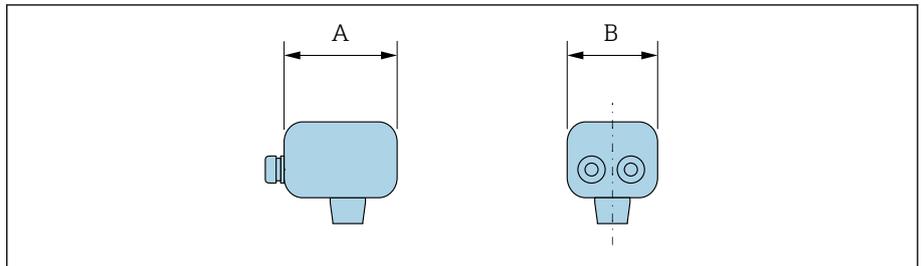

A0042716

Housing material	A <sup>1)</sup> [in]	B [in]
Polycarbonate plastic <sup>2)</sup>	4.45	4.41
Aluminum, coated	5.83	5.35


1) Depending on the cable entry used: values up to + 1.18 in

2) In conjunction with order code for "Sensor option", options CA, CB, CC, CD, CE

**DN 25 to 300 (1 to 12") aluminum half-shell housing**

Sensor with aluminum half-shell housing.

Sensor connection housing: aluminum, AlSi10Mg, coated

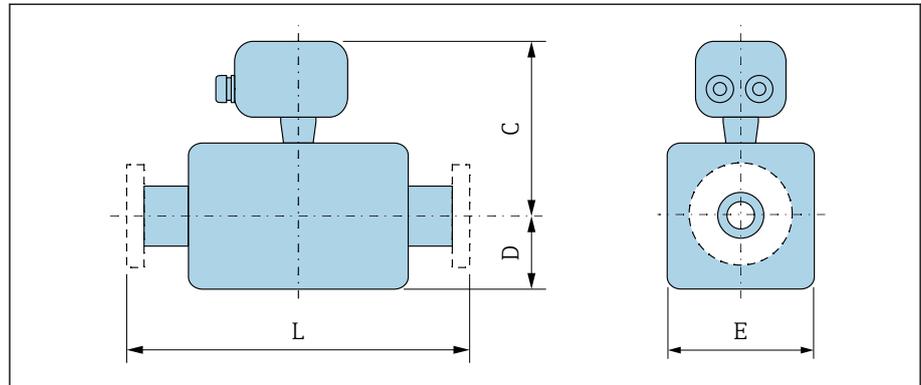


A0041519

DN		Order code for "Design"			
		Options D, E, H, I			
[mm]	[in]	C <sup>1)</sup> [in]	D [in]	E [in]	L [in]
25	1	7.76	3.31	4.72	7.87
32	-	7.76	3.31	4.72	7.87
40	1 ½	7.76	3.31	4.72	7.87
50	2	7.76	3.31	4.72	7.87
65	-	8.74	4.29	7.09	7.87
80	3	8.74	4.29	7.09	7.87
100	4	8.74	4.29	7.09	9.84
125	-	10.31	5.91	10.24	9.84
150	6	10.31	5.91	10.24	11.81
200	8	11.3	7.09	12.76	13.78
250	10	12.28	8.07	15.75	17.72
300	12	13.27	9.06	18.11	19.69

1) Reference values: dependent on the pressure rating, design and order option

**DN 25 to 300 (1 to 12") fully welded housing**

Sensor with fully welded carbon steel housing:  
 Order code for "Sensor option", options CA, CB, CC, CD, CE

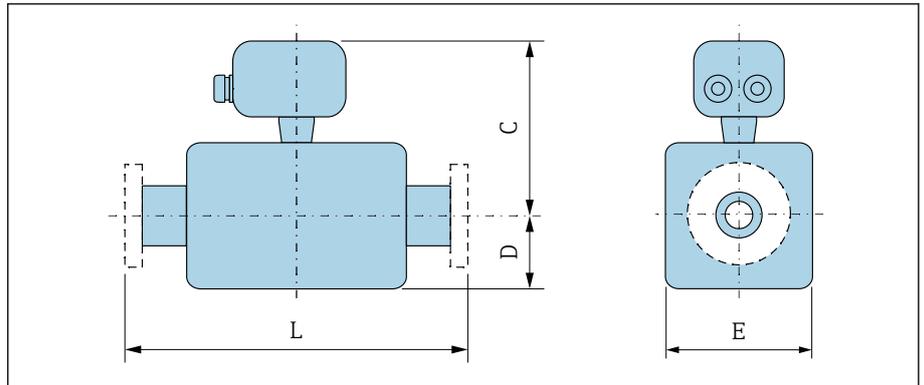


A0041519

DN		Order code for "Design"			
		Options A, E			
[mm]	[in]	C <sup>1)</sup> [in]	D <sup>1)</sup> [in]	E <sup>1)</sup> [in]	L [in]
25	1	7.44	2.76	5.51	7.87
32	-	7.44	2.76	5.51	7.87
40	1 ½	7.44	2.76	5.51	7.87
50	2	7.44	2.76	5.51	7.87
65	-	7.95	3.23	6.5	7.87
80	3	8.15	3.43	6.89	7.87
100	4	8.62	3.94	7.87	9.84
125	-	9.13	4.45	8.9	9.84
150	6	10	5.28	10.59	11.81
200	8	10.98	6.3	12.6	13.78
250	10	12.32	7.6	15.24	17.72
300	12	13.31	8.58	17.2	19.69

1) Reference values: dependent on the pressure rating, design and order option


## DN 350 to 900 (14 to 36")

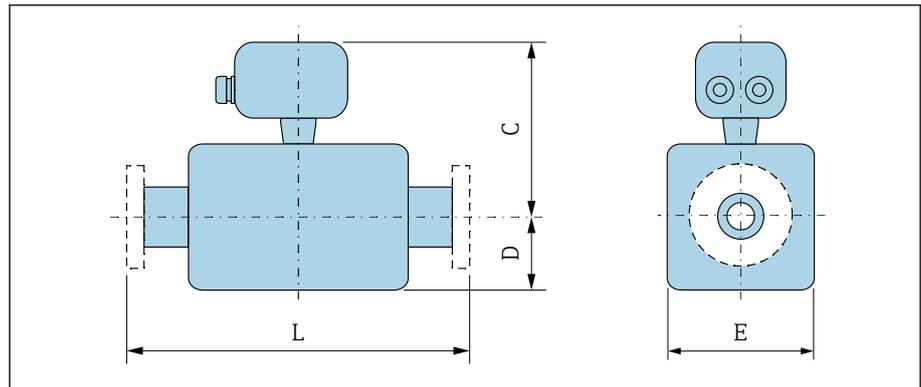

DN		Order code for "Design"							
		Options E, F			Option G			L	
[mm]	[in]	C <sup>1)</sup> [in]	D [in]	E [in]	C [in]	D [in]	E [in]	[in]	
350	14	15.55	9.65	19.29	-	-	-	21.65	
375	15	16.57	10.67	21.34	-	-	-	23.62	
400	16	16.57	10.67	21.34	-	-	-	23.62	
450	18	15.87	11.77	23.54	17.56	13.11	26.22	23.62 <sup>2)</sup>	25.59 <sup>3)</sup>
500	20	16.85	12.76	25.51	18.58	14.13	28.23	23.62	25.59
600	24	18.82	14.37	28.74	20.63	16.18	32.32	23.62	30.71
700	28	21.22	16.93	33.86	24.65	20.16	40.31	27.56	35.83
750	30	22.72	18.39	36.77	24.65	20.16	40.31	29.53	38.39
800	32	23.46	19.13	38.27	25.47	21.02	41.93	31.5	40.94
900	36	25.43	21.1	42.2	28.5	24.02	47.95	35.43	46.06

- 1) Reference values: dependent on the pressure rating, design and order option
- 2) Order code for "Design", option F "Fixed flange, short installation length"
- 3) Order code for "Design", option G "Fixed flange, long installation length"

DN 1000 to 2400 (40 to 90")

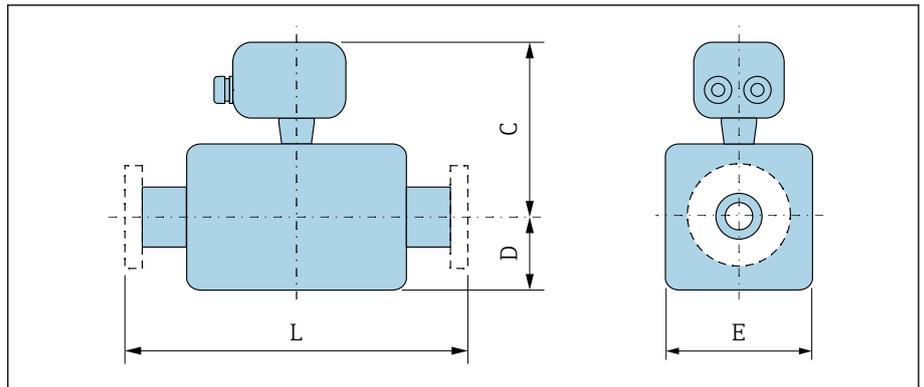

A0041519

DN		C <sup>1)</sup>	D <sup>1)</sup>	E <sup>1)</sup>	L	
[mm]	[in]	[in]	[in]	[in]	[in]	
1000	40	27.48	22.91	45.83	39.37 <sup>2)</sup>	51.18 <sup>3)</sup>
-	42	28.9	24.33	48.66	41.34	53.74
1200	48	31.97	27.4	54.8	47.24	61.42
-	54	36.42	31.85	63.66	53.15	69.09
1400	-	36.42	31.85	63.66	55.12	71.65
-	60	40.35	35.79	71.54	59.06	76.77
1600	-	40.35	35.79	71.54	62.99	81.89
-	66	42.36	37.8	75.55	64.96	84.45
1800	72	44.57	40	80	70.87	92.13
-	78	48.98	44.37	88.74	78.74	102.36
2000	-	48.98	44.37	88.74	78.74	102.36
-	84	52.91	48.31	96.61	84.65	
2200	-	52.91	48.31	96.61	86.61	
-	90	57.05	48.31	104.88	90.55	
2400	-	57.05	52.44	104.88	94.49	

1) Reference values: dependent on the pressure rating, design and order option

2) Order code for "Design", option F "Fixed flange, short installation length"

3) Order code for "Design", option G "Fixed flange, long installation length"


## Fixed flange

### Flange according to ASME B16.5, Class 150

- Carbon steel: order code for "Process connection", option A1K
- Stainless steel: order code for "Process connection", option A1S

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner →  58



A0041915


DN [in]	A [in]	B [in]	C [in]	D [in]
1	4.25	3.12	4 × Ø0.63	0.5
1 ½	5	3.88	4 × Ø0.63	0.63
2	6	4.75	4 × Ø0.75	0.69
3	7.5	6	4 × Ø0.75	0.88
4	9	7.5	8 × Ø0.75	0.88
6	11	9.5	8 × Ø0.88	0.94
8	13.5	11.75	8 × Ø0.88	1.06
10	16	14.25	12 × Ø1	1.17
12	19	17	12 × Ø1	1.19
14	21.06	18.75	12 × Ø1.13	1.39
16	23.43	21.25	16 × Ø1.13	1.46
18	25	22.75	16 × Ø1.25	1.58
20	27.56	25	20 × Ø1.25	1.7
24	32.09	29.5	20 × Ø1.37	1.89

### Flange according to ASME B16.5, Class 300

- Carbon steel: order code for "Process connection", option A2K
- Stainless steel: order code for "Process connection", option A2S

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner →  58



A0041915


DN [in]	A [in]	B [in]	C [in]	D [in]
1	4.88	3.5	4 × Ø0.75	0.63
1 ½	6.12	4.5	4 × Ø0.88	0.75
2	6.5	5	8 × Ø0.75	0.82
3	8.25	6.62	8 × Ø0.88	1.06
4	10	7.88	8 × Ø0.88	1.19
6	12.5	10.62	12 × Ø0.88	1.38

**Flange according to AWWA, Cl. D**

Order code for "Process connection", option W1K

Surface roughness: Ra 250 to 492 µin

E: Internal diameter depends on the liner → 58



A0041915

DN [in]	A [in]	B [in]	C [in]	D [in]
28	36.5	34	28 × Ø1.38	1.31
30	38.74	36	28 × Ø1.38	1.38
32	41.73	38.5	28 × Ø1.65	1.5
36	45.98	42.75	32 × Ø1.65	1.63
40	50.75	47.25	36 × Ø1.65	1.63
42	52.99	49.5	36 × Ø1.65	1.75
48	59.49	56	44 × Ø1.65	1.88
54	66.26	62.75	44 × Ø1.89	2.13
60	73.03	69.25	52 × Ø1.89	2.25
66	80	76	52 × Ø1.89	2.5
72	86.5	82.5	60 × Ø1.89	2.63
78	92.99	89	64 × Ø2.13	2.75
84	99.8	95.5	64 × Ø2.13	2.88
90	106.5	107	68 × Ø2.36	3


## Lap joint flange

### Lap joint flange according to ASME B16.5, Class 150

- **Carbon steel:** order code for "Process connection", option A12
- **Stainless steel:** order code for "Process connection", option A14

Surface roughness (flange): Ra 248 to 492  $\mu\text{in}$

F: Internal diameter depends on the liner →  58




A0042254

DN [in]	A [in]	B [in]	C [in]	D [in]	E [in]
1	4.33	3.15	4 × Ø0.63	0.55	1.93
1 ½	4.92	3.86	4 × Ø0.63	0.69	2.8
2	5.91	4.76	4 × Ø0.75	0.75	3.46
3	7.48	5.98	4 × Ø0.75	0.94	4.72
4	9.06	7.48	8 × Ø0.75	0.94	5.83
6	11.02	9.49	8 × Ø0.91	0.98	8.23
8	13.58	11.73	8 × Ø0.91	1.14	10.39
10	15.94	14.25	12 × Ø0.98	1.18	12.48
12	19.09	17.01	12 × Ø0.98	1.26	14.88

Accessories

Protective cover

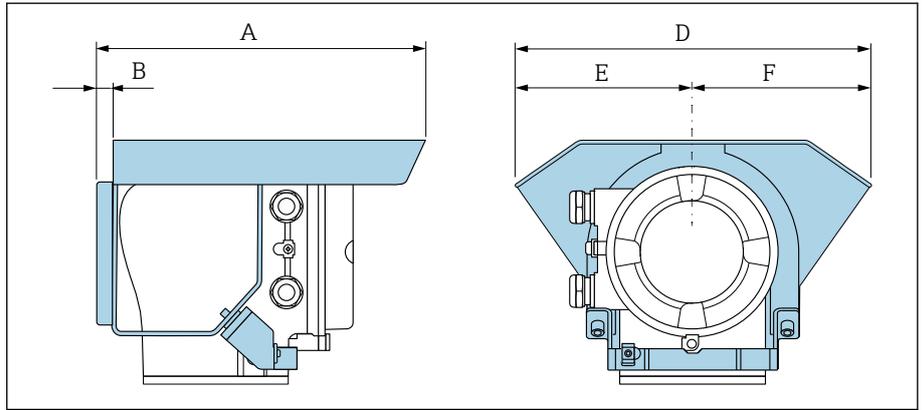


A0042332

A [in]	B [in]	D [in]	E [in]	F [in]
10.12	0.47	11.02	5.51	5.51

Ground disks for flanges


DN 25 to 300 (1 to 12")		DN	Rating	A	B	C <sup>1)</sup>	D	E	F	
		[mm]	[in]	[in]	[in]	[in]	[in]	[in]	[in]	
		25	1"	2)	3.44	0.26	0.08	1.02	2.44	3.05
		32	1 ¼"	2)	3.72	0.26	0.08	1.38	3.15	3.44
		40	1 ½"	2)	4.06	0.26	0.08	1.61	3.23	3.98
		50	2"	2)	4.25	0.26	0.08	2.05	3.98	4.55
		65	2 ½"	2)	4.65	0.26	0.08	2.68	4.76	5.18
		80	3"	2)	5.31	0.26	0.08	3.15	5.16	6.08
		100	4"	2)	6.02	0.26	0.08	4.09	6.14	7.34
		125	5"	2)	6.3	0.26	0.08	5.12	7.36	8.13
		150	6"	2)	7.24	0.26	0.08	6.22	8.54	10.08
		200	8"	2)	8.07	0.26	0.08	8.11	10.51	11.34
		250	10"	2)	9.45	0.26	0.08	10.24	12.91	14.13
		300	12"	PN 10 PN 16 Cl. 150	10.75	0.26	0.08	12.28	14.76	16.26

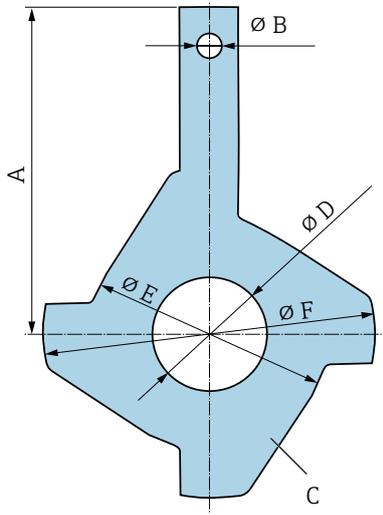

A0042332

- 1) Material thickness
- 2) In the case of DN 1" to 10", ground disks can be used for all the flange standards/pressure ratings which can be supplied in the standard version.


DN		Rating	A	B	C <sup>1)</sup>	D	E	F
[mm]	[in]							
300	12"	PN 25 JIS 10K JIS 20K	10.55	0.35	0.08	12.2	14.76	15.91
350	14"	PN 6 PN 10 PN 16	14.37	0.35	0.08	13.5	16.54	18.86
375	15"	PN 16	15.55	0.35	0.08	15.47	18.15	20.59
400	16"	PN 6 PN 10 PN 16	15.55	0.35	0.08	15.47	18.5	21.34
450	18"	PN 6 PN 10 PN 16	16.42	0.35	0.08	17.28	20.67	22.95
500	20"	PN 6 PN 10 PN 16	18.11	0.35	0.08	19.41	22.64	25.59
600	24"	PN 6 PN 10 PN 16	20.55	0.35	0.08	23.35	26.61	30.16

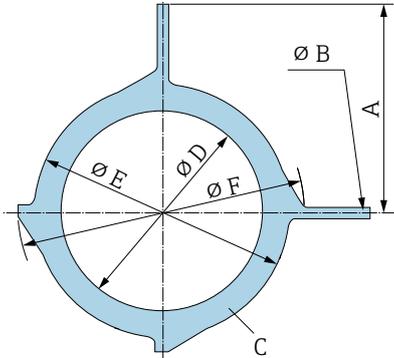

A0042323

1) Material thickness

DN		Rating	A	B	C <sup>1)</sup>	D	E
[mm]	[in]						
700	28"	PN 6 PN10 PN16 Cl, D	18.11 18.9 19.29 19.45	0.25	0.08	27.44 27.28 27.05 27.28	30.94 32.01 31.77 32.76
750	30"	Cl, D	20.59	0.25	0.08	29.25	32.8
800	32"	PN 6 PN 10 PN 16 Cl, D	20.47 21.26 21.65 22.09	0.25	0.08	31.46 31.3 31.06 31.3	35.16 36.22 35.98 37.01
900	36"	PN 6 PN 10 PN 16 Cl, D	22.44 23.23 23.43 24.21	0.25	0.08	35.31 35.16 34.88 35.16	39.09 40.16 39.92 41.26
1000	40"	PN 6 PN 10 PN 16 Cl, D	24.41 25.59 25.98 26.57	0.25	0.08	39.33 39.17 38.9 39.17	43.03 44.37 44.53 45.79
-	42"	PN 6	27.72	0.25	0.08	41.1	48.03
1200	48"	PN 6 PN 10 PN 16 Cl, D	28.86 29.92 30.94 30.51	0.25	0.08	47.36 47.09 47.09 46.77	51.57 52.91 54.53 52.95

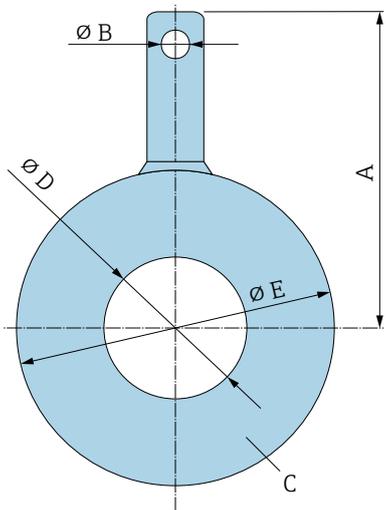

A0042324

1) Material thickness

## Local display


---

Operating concept	102
Operating options	102
Operating tools	103

## Operating concept

Operation method	<ul style="list-style-type: none"> <li>Operation via local display with touch screen.</li> <li>Operation via SmartBlue App.</li> </ul>
Menu structure	<p>Operator-oriented menu structure for user-specific tasks:</p> <ul style="list-style-type: none"> <li>Diagnostics</li> <li>Application</li> <li>System</li> <li>Guidance</li> <li>Language</li> </ul>
Commissioning	<ul style="list-style-type: none"> <li>Commissioning via a guided menu (<b>Commissioning</b> wizard).</li> <li>Menu guidance with interactive help function for individual parameters.</li> </ul>
Reliable operation	<ul style="list-style-type: none"> <li>Operation in local language.</li> <li>Uniform operating philosophy in device and in the SmartBlue App.</li> <li>Write protection</li> <li>When electronics modules are replaced: configurations are transferred using the T-DAT Backup device memory. The device memory contains process data, device data and the event logbook. No reconfiguration is necessary.</li> </ul>
Diagnostic behavior	<p>Efficient diagnostic behavior increases measurement availability:</p> <ul style="list-style-type: none"> <li>Open troubleshooting measures via local display and SmartBlue App.</li> <li>Diverse simulation options.</li> <li>Logbook of events that have occurred.</li> </ul>

## Operating options

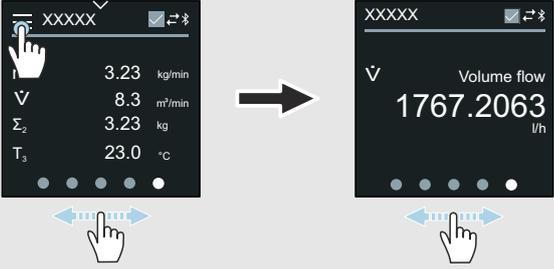Local display	 <p>Display elements:</p> <ul style="list-style-type: none"> <li>LCD touch screen</li> <li>Depends on the orientation, automatic alignment of local display.</li> <li>Configuration of display format for measured variables and status variables.</li> </ul> <p>Operating elements:</p> <ul style="list-style-type: none"> <li>Touch screen</li> <li>Local display can also be accessed in the hazardous area.</li> </ul>
SmartBlue App	<ul style="list-style-type: none"> <li>The SmartBlue App allows the user to put devices into operation and operate them.</li> <li>Based on Bluetooth.</li> <li>No separate driver required.</li> <li>Available for mobile handheld terminals, tablets and smartphones.</li> <li>Suitable for convenient and secure access to devices in hard-to-reach locations or in hazardous areas.</li> <li>Can be used within a 20 m (65.6 ft) radius of the device.</li> <li>Encrypted and secure data transmission.</li> <li>No data loss during commissioning and maintenance.</li> <li>Diagnostic information and process information in real time.</li> </ul>

## Operating tools

Operating tools	Operating unit	Interface	Additional information
DeviceCare SFE100	<ul style="list-style-type: none"> <li>▪ Notebook</li> <li>▪ PC</li> <li>▪ Tablet with Microsoft Windows system</li> </ul>	<ul style="list-style-type: none"> <li>▪ CDI service interface</li> <li>▪ Fieldbus protocol</li> </ul>	Innovation brochure IN01047S
FieldCare SFE500	<ul style="list-style-type: none"> <li>▪ Notebook</li> <li>▪ PC</li> <li>▪ Tablet with Microsoft Windows system</li> </ul>	<ul style="list-style-type: none"> <li>▪ CDI service interface</li> <li>▪ Fieldbus protocol</li> </ul>	Operating Instructions BA00027S and BA00059S
SmartBlue App	<ul style="list-style-type: none"> <li>▪ Devices with iOS: iOS9.0 or higher</li> <li>▪ Devices with Android: Android 4.4 KitKat or higher</li> </ul>	Bluetooth	Endress+HauserSmartBlue App: <ul style="list-style-type: none"> <li>▪ Google Playstore (Android)</li> <li>▪ iTunes Apple Shop (iOS devices)</li> </ul>
Device Xpert	Field Xpert SFX 100/350/370	HART fieldbus protocol	Operating Instructions BA01202S



## Certificates and approvals

---

Non-Ex approval	106
Pressure Equipment Directive	106
Drinking water approval	106
Pharmaceutical compatibility	106
HART certification	106
Radio approval	106
Additional approvals	106
Other standards and guidelines	106

### Non-Ex approval

- cSAus
- EAC

### Pressure Equipment Directive

- CRN
- PED Cat. II/III

### Drinking water approval

- ACS
- KTW/W270
- NSF 61
- WRAS BS 6920

### Pharmaceutical compatibility

- FDA
- USP Class VI
- TSE/BSE Certificate of Suitability

### HART certification

The device is certified and registered by the FieldComm Group. The measuring system meets all the requirements of the following specifications:

- Certified according to HART 7
- The device can also be operated with certified devices of other manufacturers (interoperability).

### Radio approval

The device has radio approvals.

### Additional approvals

VDS (fire protection)

### Other standards and guidelines

- IEC/EN 60529  
Degrees of protection provided by enclosures (IP code)
- IEC/EN 60068-2-6  
Environmental influences: Test procedure - Test Fc: vibrate (sinusoidal)
- IEC/EN 60068-2-31  
Environmental influences: Test procedure - Test Ec: shocks due to rough handling, primarily for devices.
- IEC/EN 61010-1  
Safety requirements for electrical equipment for measurement, control and laboratory use - general requirements.
- CAN/CSA-C22.2 No. 61010-1-12  
Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use - Part 1 General Requirements.
- IEC/EN 61326  
Emission in accordance with Class A requirements. Electromagnetic compatibility (EMC requirements)
- ANSI/ISA-61010-1 (82.02.01)  
Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use - Part 1 General Requirements.
- NAMUR NE 21  
Electromagnetic compatibility (EMC) of industrial process and laboratory control equipment.

- NAMUR NE 32  
Data retention in the event of a power failure in field and control instruments with microprocessors.
- NAMUR NE 43  
Standardization of the signal level for the breakdown information of digital transmitters with analog output signal.
- NAMUR NE 53  
Software of field devices and signal-processing devices with digital electronics.
- NAMUR NE 105  
Specifications for integrating fieldbus devices in engineering tools for field devices.
- NAMUR NE 107  
Self-monitoring and diagnosis of field devices.
- NAMUR NE 131  
Requirements for field devices for standard applications.
- ETSI EN 300 328  
Guidelines for 2.4 GHz radio components
- EN 301489  
Electromagnetic compatibility and radio spectrum matters (ERM).



## Application packages

---

Use	110
Heartbeat Verification + Monitoring	110

## Use

Many different application packages are available to enhance the functionality of the device. Such packages might be needed to address safety aspects or specific application requirements.

The application packages can be ordered with the device or subsequently from Endress+Hauser. Detailed information on the relevant order code is available from your local Endress+Hauser sales organization or on the product page of the Endress+Hauser website: [www.endress.com](http://www.endress.com).

## Heartbeat Verification + Monitoring

### Heartbeat Verification

Availability depends on the product structure.

Meets the requirement for traceable verification to DIN ISO 9001:2008 Chapter 7.6 a) "Control of monitoring and measuring equipment":

- Functional testing in the installed state without interrupting the process.
- Traceable verification results on request, including a report.
- Simple testing process with local operation or other operating interfaces.
- Clear measuring point assessment (pass/fail) with high test coverage within the framework of manufacturer specifications.
- Extension of calibration intervals according to operator's risk assessment.

### Heartbeat Monitoring

Availability depends on the product structure.

Heartbeat Monitoring continuously supplies data, which are characteristic of the measuring principle, to an external condition monitoring system for the purpose of preventive maintenance or process analysis. These data enable the operator to:

- Draw conclusions - using these data and other information - about the impact the process influences, e.g. corrosion, abrasion, formation of buildup, have on the measuring performance over time.
- Schedule servicing in time.
- Monitor the process quality or product quality, e.g. gas pockets.

## Accessories

---

Device-specific accessories	112
Communication-specific accessories	113
Service-specific accessory	113
System components	114

## Device-specific accessories

### Transmitter

Accessories	Description	Order number
Proline 10 transmitter	 Installation Instructions EA01350D	5XBBXX-*...*
Protective cover	Protects the device from weather exposure:  Installation Instructions EA01351D	71502730
Connecting cable	Can be ordered with the device. The following cable lengths are available: order code for "Cable, sensor connection" <ul style="list-style-type: none"> <li>▪ 5 m (16 ft)</li> <li>▪ 10 m (32 ft)</li> <li>▪ 20 m (65 ft)</li> <li>▪ User-configurable cable length (m or ft)</li> </ul>  Max. cable length: 200 m (660 ft)	DK5013-*...*
Ground cable	1 ground cable set for potential equalization, consisting of 2 ground cables	

### Sensor

Accessories	Description
Grounding rings	Ground medium in lined measuring pipes.  Installation Instructions EA00070D

## Communication-specific accessories

Accessories	Description
Commubox FXA195 USB/HART modem	Intrinsically safe HART communication with FieldCare and FieldXpert  Technical Information TI00404F
Commubox FXA291	Connects the Endress+Hauser devices with the CDI interface (= Endress+Hauser Common Data Interface) to the USB interface of a personal computer or laptop.  Technical Information TI405C/07
HART Loop Converter HMX50	Is used to evaluate and convert dynamic HART process variables to analog current signals or limit values.  <ul style="list-style-type: none"> <li>▪ Technical Information TI00429F</li> <li>▪ Operating Instructions BA00371F</li> </ul>
Fieldgate FXA42	Transmission of measured values from connected 4 to 20 mA analog and digital devices.  <ul style="list-style-type: none"> <li>▪ Technical Information TI01297S</li> <li>▪ Operating Instructions BA01778S</li> <li>▪ Product page: <a href="http://www.endress.com/fxa42">www.endress.com/fxa42</a></li> </ul>
Field Xpert SMT70	Tablet PC for the configuration of the device. Enables mobile Plant Asset Management to manage the devices with a digital communication interface. Suitable for Zone 2.  <ul style="list-style-type: none"> <li>▪ Technical Information TI01342S</li> <li>▪ Operating Instructions BA01709S</li> <li>▪ Product page: <a href="http://www.endress.com/smt70">www.endress.com/smt70</a></li> </ul>
Field Xpert SMT77	Tablet PC for the configuration of the device. Enables mobile Plant Asset Management to manage the devices with a digital communication interface. Suitable for Zone 1.  <ul style="list-style-type: none"> <li>▪ Technical Information TI01418S</li> <li>▪ Operating Instructions BA01923S</li> <li>▪ Product page: <a href="http://www.endress.com/smt77">www.endress.com/smt77</a></li> </ul>

## Service-specific accessory

Accessories	Description	Order number
Applicator	Software for selecting and sizing Endress+Hauser devices.	<a href="https://portal.endress.com/webapp/applicator">https://portal.endress.com/webapp/applicator</a>
W@M Life Cycle Management	<ul style="list-style-type: none"> <li>▪ Information platform with software applications and services</li> <li>▪ Supports the entire life cycle of the facility.</li> </ul>	<a href="http://www.endress.com/lifecyclemanagement">www.endress.com/lifecyclemanagement</a>
FieldCare	FDT-based plant asset management software from Endress+Hauser. Management and configuration of Endress+Hauser devices.  Operating Instructions BA00027S and BA00059S	<ul style="list-style-type: none"> <li>▪ Device driver: <a href="http://www.endress.com">www.endress.com</a> → Download Area</li> <li>▪ CD-ROM (contact Endress+Hauser)</li> <li>▪ DVD (contact Endress+Hauser)</li> </ul>
DeviceCare	Software for connecting and configuring Endress+Hauser devices.  Innovation brochure IN01047S	<ul style="list-style-type: none"> <li>▪ Device driver: <a href="http://www.endress.com">www.endress.com</a> → Download Area</li> <li>▪ CD-ROM (contact Endress+Hauser)</li> <li>▪ DVD (contact Endress+Hauser)</li> </ul>

## System components

Accessories	Description
Memograph M	Graphic data manager: <ul style="list-style-type: none"><li>▪ Record measured values</li><li>▪ Monitor limit values</li><li>▪ Analyze measuring points</li></ul>  <ul style="list-style-type: none"><li>▪ Technical Information TI00133R</li><li>▪ Operating Instructions BA00247R</li></ul>
iTEMP	Temperature transmitter: <ul style="list-style-type: none"><li>▪ Measure the absolute pressure and gauge pressure of gases, vapors and liquids</li><li>▪ Read the medium temperature</li></ul>  "Fields of Activity" document FA00006T

---



71516521

[www.addresses.endress.com](http://www.addresses.endress.com)

---