

General Specifications

GS 32Q06D10-31E

Models SSC60S, SSC60D
Safety Control Unit,
Duplexed Safety Control Unit
(for Vnet/IP, Rack Mountable Type)

ProSafe-RS

■ GENERAL

This GS provides the hardware specifications of the safety control unit for Vnet/IP, which are intelligent parts of the safety control station (SCS).

■ HARDWARE SPECIFICATIONS

For the criteria for the installation environment, refer to "ProSafe-RS Safety Instrumented System Overview (for Vnet/IP)" (GS 32P01B10-01EN).

● Module Configuration

Power Supply Module (SPW481, SPW482 or SPW484): 2 modules

Processor Module (S2CP471 or SCP461): 2 modules for dual-redundant configuration. (*1)

*1: A dual-redundant configuration is enabled by using 2 identical modules with same model code (S2CP471 or SCP461).

● Memory Protection at Power Failure

Application program is stored in flash memory.
Processor module operation data is stored in NVRAM (nonvolatile memory).

● Temperature Adaptability

A fan unit is provided for high temperature use where the safety control units (SSC60S-F/SSC60D-F) ambient temperature exceeds 40 °C.

● Communications Interface

Vnet/IP interface: Dual-redundant
ESB bus interface: Dual-redundant

● Communication on Vnet/IP

Communication speed: 100 Mbps, Full duplex
Connection: UTP cable (CAT5e or higher), RJ45 connector

Interface: 100Base-TX compliance


Max. distance: 100 m (distance between SSC60S/SSC60D and Layer 2 switch)

● Connecting Safety Node Units

Up to 13 safety node units can be connected to a safety control unit using SEC402 ESB bus coupler module and adding CFS1350 Node Expansion Package.

Up to 9 safety node units can be connected to a safety control unit using SEC401 ESB bus coupler module.

For installation, ESB bus coupler modules (SEC402/SEC401) should be mounted on 7-th and 8-th slots. ESB bus can be extended by Optical ESB bus repeater modules.

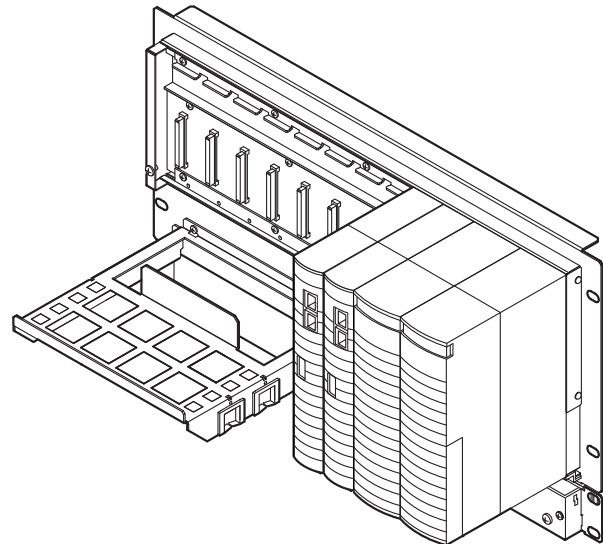

F01E.ai

● Number of I/O Modules Mounted

Up to eight for each safety control unit

Up to 110 for each SCS (using SEC402 ESB bus coupler module and CFS1350 Node Expansion Package)

Up to 78 for each SCS (using SEC401 ESB bus coupler module)

● Power Requirements

Specify suffix codes.

Voltage: 100 to 120 V AC, 50 or 60 Hz

Voltage: 220 to 240 V AC, 50 or 60 Hz

Voltage: 24 V DC

● Power Consumption

• SSC60S-S/SSC60D-S

100 to 120 V AC model: 200 VA

200 to 240 V AC model: 230 VA

24 V DC model: 5.5 A

• SSC60S-F/SSC60D-F

100 to 120 V AC model: 240 VA

200 to 240 V AC model: 290 VA

24 V DC model: 7.0 A

● Battery

• S2CP471

Part No. : S9450FE

Battery's recommended replacement period: Three years under the average ambient temperature of 30 °C or less.

• SCP461

Part No. : S9185FA

Battery's recommended replacement period: Three years under the average ambient temperature of 30 °C or less.

● Weight

Approximately 7.9 kg (for SSC60S-S)
 Approximately 13 kg (for SSC60S-F)
 Approximately 8.5 kg (for SSC60D-S)
 Approximately 13 kg (for SSC60D-F)

● Mounting

Rack mounting: SSC60S-S/SSC60D-S rack mounted with eight M5 screws
 SSC60S-F/SSC60D-F rack mounted with twelve M5 screws
 Insulating Bushing: Supplied as accessories

The SCS is composed of a safety control unit, safety node units and an ESB bus connecting them.

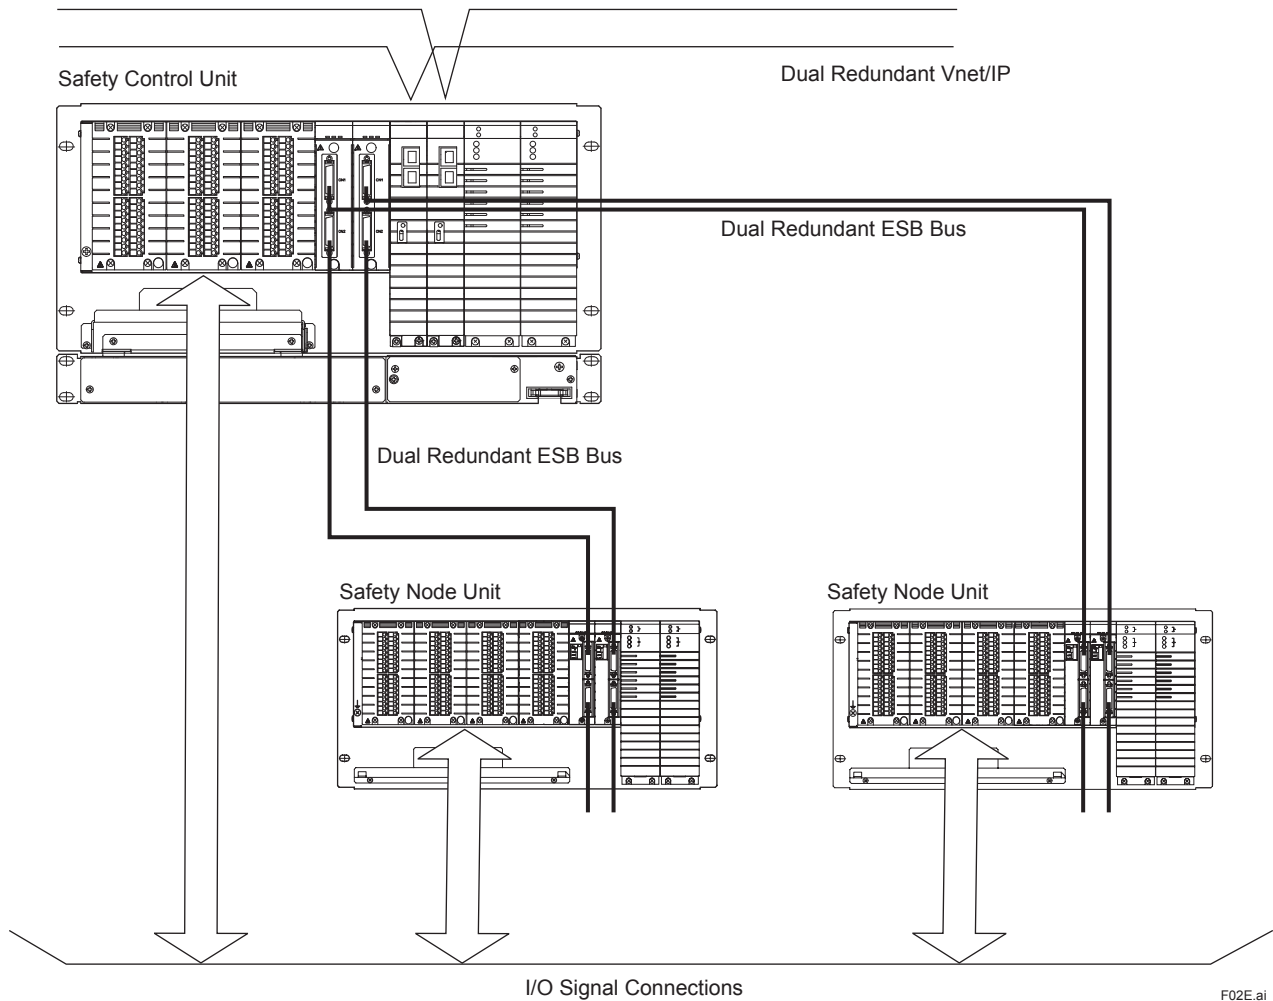


Figure SCS Configuration

● Connections

Power Supply: Connected with M4 screws.
 Grounding: Connected with M4 screws.


● Conformity Standards

Refer to "ProSafe-RS Standards Compliant Models" (GS 32P01B60-01EN).

EXTERNAL DIMENSIONS

● SSC60S-S, SSC60S-F, SSC60D-S, SSC60D-F

Unit: mm

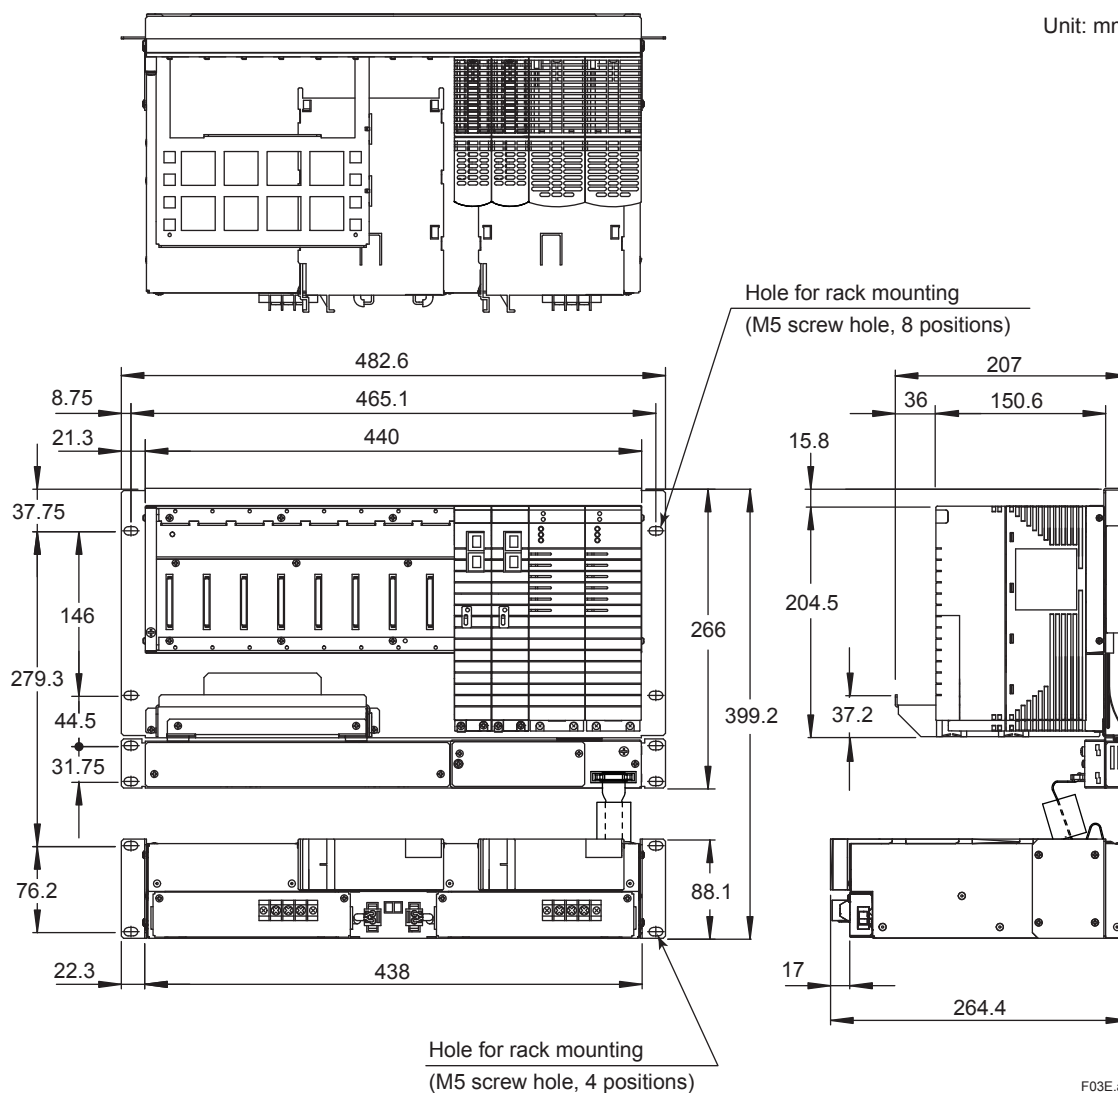

Nominal Tolerances:

When the reference dimension is over 0.5 mm and equal or less than 120 mm, its nominal tolerance is ± 0.8 mm, while its combination of nominal tolerance is ± 1.5 mm.

When the reference dimension is over 120 mm, its nominal tolerance is in accordance with JEM 1459.

■ MODEL AND SUFFIX CODES

Safety Control Unit

		Description
Model	SSC60S	Safety Control Unit (for Vnet/IP, Rack Mountable Type) (*1) (*2)
Suffix Codes	-S	Standard Type (-20 to 40 °C) (with ISA Standard G3)
	-F	Wide range temperature (-20 to 70 °C) type (with Fan unit and ISA Standard G3)
	2	Dual-redundant power supply
	5	With no explosion protection
	E	With explosion protection
	1	100-120 V AC power supply
	2	220-240 V AC power supply
	4	24 V DC power supply
Option Code	1	CFS1300 Safety Control Function License (R3) (*3)
	2	Without Safety Control Function License (R4.01 or later)
Option Code	/ATDOC	Explosion Protection Manual (*4)

Note: Install the 19-inch rack mountable type devices in a keyed metallic cabinet to conform to the safety standards, the EMC conformity standards and the explosion protection standards.

For details, refer to ProSafe-RS Installation Guidance (TI 32P01J10-01EN).

Note: Select the option code "/ATDOC" to follow the ATEX Directive for use in potentially explosive atmospheres.

*1: Shipped with SCP461. Also S2CP471 is usable. Replacing from SCP461 to S2CP471 by a user is prohibited. Replacement work must be done by the service engineer authorized by Yokogawa Electric Corporation. See GS 32P06D20-01EN.

*2: When SSC60S that is mounted with S2CP471 is used with ProSafe-RS R3.01, R3.02, R4.01, R4.02, R4.03, or R4.04, be sure to apply the software patch for supporting S2CP471.

*3: SSC60S-□□□□1 can be used with R4.01 or later.

*4: Select the option code "/ATDOC" to follow the ATEX/IECEx Directive when any components are used for explosion protection.

Duplexed Safety Control Unit

		Description
Model	SSC60D	Duplexed Safety Control Unit (for Vnet/IP, Rack Mountable Type) (*1) (*2)
Suffix Codes	-S	Standard Type (-20 to 40 °C) (with ISA Standard G3)
	-F	Wide range temperature (-20 to 70 °C) type (with Fan unit and ISA Standard G3)
	2	Dual-redundant power supply
	5	With no explosion protection
	E	With explosion protection
	1	100-120 V AC power supply
	2	220-240 V AC power supply
	4	24 V DC power supply
Option Code	1	CFS1300 Safety Control Function License (R3) (*3)
	2	Without Safety Control Function License (R4.01 or later)
Option Code	/ATDOC	Explosion Protection Manual (*4)

Note: Install the 19-inch rack mountable type devices in a keyed metallic cabinet to conform to the safety standards, the EMC conformity standards and the explosion protection standards.

For details, refer to ProSafe-RS Installation Guidance (TI 32P01J10-01EN).

Note: Select the option code "/ATDOC" to follow the ATEX Directive for use in potentially explosive atmospheres.

*1: Shipped with a pair of SCP461. Also a pair of S2CP471 is usable. Replacing from SCP461 to S2CP471 by a user is prohibited. Replacement work must be done by the service engineer authorized by Yokogawa Electric Corporation. See GS 32P06D20-01EN.

*2: When SSC60D that is mounted with S2CP471 is used with ProSafe-RS R3.01, R3.02, R4.01, R4.02, R4.03, or R4.04, be sure to apply the software patch for supporting S2CP471.

*3: SSC60D-□□□□1 can be used with R4.01 or later.

*4: Select the option code "/ATDOC" to follow the ATEX/IECEx Directive when any components are used for explosion protection.

■ SOFTWARE

When a release number of software is R3, specify “CFS1300 Safety Control Function License” by suffix code. When connecting 10 or more safety node units to a safety control unit, the safety control unit requires CFS1350 Node Expansion Package. For details on the CFS1300 and CFS1350 specifications, refer to “Safety Control Functions Package, Node Expansion Package” (GS 32Q03B10-31E).

When a release number of software is R4.01 or later, specify “Without Safety Control Function License” by suffix code. Software licenses are required for SSC60S and SSC60D separately. For details, refer to “Safety Control Function (for SSC60□), Safety Control Function for SCS Simulator (for SSC60□)” (GS 32P03B10-01EN) and “Project I/O License” (GS 32P03A10-01EN).

■ STANDARD ACCESSORIES

The safety control unit is supplied with the following accessories.

Accessory	Part number	Description	Quantity	Remark
Insulating bushing	S9049PM	SSC60S-S/SSC60D-S	8	Accessories
		SSC60S-F/SSC60D-F	12	

■ ORDERING INFORMATION

Specify the model and suffix codes when ordering.

For selecting the right products for explosion protection, please refer to TI 32S01J30-01E without fail.

■ TRADEMARK ACKNOWLEDGMENT

The names of corporations, organizations, products and logos herein are either registered trademarks or trademarks of Yokogawa Electric Corporation and their respective holders.